

**WATLOW ANAFAZE SYSTEM 32  
HARDWARE  
Installation And Operation Manua**

Revision 5  
December 21, 1988

Watlow Anafaze  
344 Westridge DR  
Watsonville, CA 95076  
Phone: 831-724-3800  
Fax: 831-724-0320

Copyright (c) 1987-1988. All RIGHTS RESERVED: No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form by any means; electronic, mechanical, photo copying, recording, or otherwise, without the prior written permission of Watlow Anafaze

Printed in U.S.A.

## STATEMENT OF WARRANTY

ANAFAZE, Incorporated warrants that the Products furnished under this Agreement will be free from material defects in material and workmanship for a period of 90 days from the date of shipment. The customer shall provide notice to ANAFAZE, Incorporated of any such defect within one week after the Customer's discovery of such defect. The sole obligation and liability of ANAFAZE, Incorporated under this warranty shall be to repair or replace, at its option, without cost to the Customer, the product or part which is so defective and as to which such notice is given.

Upon request by ANAFAZE, Incorporated, the product or part claimed to be defective shall immediately be returned at the Customer's expense to ANAFAZE, Inc. Replaced or repaired products or parts will be shipped to the Customer at the expense of ANAFAZE, Incorporated

There shall be no warranty or liability for any products or parts which have been subject to misuse, accident, negligence, failure of electric power or modification by the Customer without ANAFAZE, Incorporated's written approval. Final determination of warranty eligibility shall be made by ANAFAZE, Incorporated. If a warranty claim is considered invalid for any reason, the Customer will be charged for services performed and expenses incurred by ANAFAZE, Incorporated in handling and shipping the returned unit.

As to replacement parts supplied or repairs made during the original warranty period, the warranty period of the replacement or repaired part shall terminate with the termination of the warranty period with respect to the original product or part.

**THE FOREGOING WARRANTY CONSTITUTES THE SOLE LIABILITY OF ANAFAZE INCORPORATED AND THE CUSTOMER'S SOLE REMEDY WITH RESPECT TO THE PRODUCTS AND IS IN LIEU OF ALL OTHER WARRANTIES, LIABILITIES AND REMEDIES. EXCEPT AS THUS PROVIDED, ANAFAZE, INC. DISCLAIMS ALL WARRANTIES, EXPRESS OR IMPLIED, INCLUDING ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE.**

**PLEASE NOTE EXTERNAL SAFETY DEVICES MUST BE USED WITH THIS EQUIPMENT SEE WARNING ON NEXT PAGE.**

**PLEASE -- See last page to register your name and address with ANAFAZE for technical updates.**

## **WARNING**

**ANAFAZE HAS MADE EFFORTS TO ENSURE THE RELIABILITY AND SAFETY OF THE SYSTEM 32 AND PROVIDE RECOMMENDATIONS FOR ITS SAFE USE IN SYSTEMS APPLICATIONS. PLEASE NOTE THAT IN ANY APPLICATION, FAILURES CAN OCCUR THAT WILL RESULT IN FULL CONTROL OUTPUTS OR OTHER OUTPUTS THAT MAY CAUSE DAMAGE OR UNSAFE CONDITIONS IN THE EQUIPMENT OR PROCESS CONNECTED TO THE ANAFAZE SYSTEM 32.**

**GOOD ENGINEERING PRACTICES, ELECTRICAL CODES, AND INSURANCE REGULATIONS REQUIRE INDEPENDENT, EXTERNAL, SAFETY DEVICES BE USED TO PREVENT POTENTIALLY DANGEROUS OR UNSAFE CONDITIONS ASSUMING THAT THE SYSTEM 32 CAN FAIL WITH OUTPUTS FULL ON, OR OUTPUTS FULL OFF, OR OTHER CONDITIONS THAT WOULD BE UNEXPECTED.**

**THE SYSTEM 32 INCLUDES A RESET CIRCUIT THAT WILL SET THE CONTROL OUTPUTS TO THE DATA STORED IN THE EEROM IF THE MICROPROCESSOR RESETS -- NORMALLY THE RESULT OF A POWER FAILURE AND POWER RETURN. THE COMPUTER OR OTHER HOST DEVICE SHOULD BE PROGRAMMED TO AUTOMATICALLY RELOAD THE DESIRED OPERATING CONSTANTS, OR SAFE VALUES FOR THE PROCESS, UPON RETURN OF SYSTEM POWER. THE COMPUTER CAN ALSO BE PROGRAMMED TO CHECK PROCESS DATA AND CAUSE ALARMS INCLUDING CONTACT OUTPUTS FOR AUTOMATIC SHUT DOWN TO ASSIST IN PREVENTING DANGEROUS OR UNSAFE CONDITIONS. ANAFAZE WILL BE PLEASED TO PROVIDE APPLICATION ASSISTANCE AND PROGRAMMING IF DESIRED. IN ANY EVENT, THESE SAFETY FEATURES DO NOT ELIMINATE THE NEED TO PROVIDE EXTERNAL, INDEPENDENT SAFETY DEVICES IN POTENTIALLY DANGEROUS OR UNSAFE CONDITIONS.**

**ANAFAZE ALSO OFFERS AN OPTIONAL SOFTWARE PROGRAM FOR IBM PC COMPATIBLE COMPUTERS THAT WILL RELOAD THE SYSTEM 32 WITH THE CURRENT VALUES IN THE COMPUTER MEMORY UPON A RESET. THE USER MUST INSURE THAT THIS WILL BE SAFE FOR THE PROCESS. THIS FEATURE STILL DOES NOT ELIMINATE THE NEED FOR APPROPRIATE EXTERNAL, INDEPENDENT SAFETY DEVICES.**

**PLEASE CONTACT ANAFAZE IMMEDIATELY IF THERE ARE ANY QUESTIONS ABOUT SYSTEM SAFETY**

## TABLE OF CONTENTS

<b>1.0 INTRODUCTION</b>	<b>1</b>
<b>1.1 SYSTEM FEATURES</b>	<b>1</b>
<b>1.2 PLUG IN SYSTEM 32 MODULES</b>	<b>2</b>
<b>1.3 ANASOFT 32 -- POWERFUL OPERATING SOFTWARE</b>	<b>4</b>
<b>2.0 SPECIFICATIONS</b>	<b>6</b>
<b>2.1 ANALOG INPUTS</b>	<b>6</b>
<b>2.2 OPERATING PARAMETERS</b>	<b>7</b>
<b>2.3 REPORTING PARAMETERS</b>	<b>7</b>
<b>2.4 COMMUNICATIONS</b>	<b>7</b>
<b>2.5 CONTROL AND ALARM OUTPUTS</b>	<b>8</b>
<b>2.6 DIGITAL INPUT OR OUTPUT</b>	<b>8</b>
<b>2.7 ANALOG OUTPUTS</b>	<b>8</b>
<b>2.8 GENERAL</b>	<b>8</b>
<b>2.9 SUBASSEMBLY IDENTIFICATION</b>	<b>9</b>
<b>3.0 INSTALLATION</b>	<b>10</b>
<b>3.1 PHYSICAL CONSIDERATIONS</b>	<b>10</b>
<b>3.2 CONFIGURATION</b>	<b>14</b>
<b>3.3 AC POWER INPUT</b>	<b>16</b>
<b>4.0 COMMUNICATIONS SET-UP AND CONNECTIONS</b>	<b>17</b>
<b>4.1 RS-232</b>	<b>17</b>
<b>4.2 CURRENT LOOP</b>	<b>18</b>
<b>4.3 RS-485</b>	<b>19</b>
<b>5.0 ANALOG INPUTS</b>	<b>22</b>
<b>5.1 COMMON MODE VOLTAGE</b>	<b>22</b>
<b>5.2 NORMAL MODE VOLTAGE</b>	<b>22</b>
<b>5.3 GROUNDING</b>	<b>22</b>
<b>5.4 SOURCE IMPEDANCE</b>	<b>22</b>
<b>5.5 ANALOG INPUT MODULES</b>	<b>23</b>
<b>5.6 A32-RRIAM -- REED RELAY ANALOG INPUT MODULE</b>	<b>23</b>
<b>5.7 A32-SSAIM -- SOLID STATE ANALOG INPUT MODULE</b>	<b>26</b>
<b>5.8 SCALING AND CALIBRATION</b>	<b>27</b>
<b>5.9 DIAGRAMS OF TYPICAL INPUTS</b>	<b>28</b>
<b>5.10 ANALOG INPUT CONNECTIONS</b>	<b>29</b>
<b>6.0 CONTROL OUTPUTS</b>	<b>31</b>
<b>6.1 PROCESSOR I/O MODULE</b>	<b>31</b>
<b>6.2 PROCESSOR I/O [A32-PIOM] PID OUTPUT CONNECTIONS</b>	<b>34</b>
<b>6.3 ANALOG OUTPUT MODULE A32-AOM</b>	<b>36</b>

<b>7.0 DETAILED MODULE DESCRIPTIONS</b>	<b>38</b>
7.1 PROCESSOR I/O MODULE -- A32-PIOM	38
7.2 REED RELAY ANALOG INPUT MODULE -- A32-RRAIM	39
7.3 SOLID STATE ANALOG INPUT MODULE -- A32-SSAIM	41
7.4 ANALOG OUTPUT MODULE -- A32-AOM	41
7.5 PULSE INPUT MODULE -- A32-PIM	42
7.6 POWER SUPPLY----PART NO. A32-PS	42
7.7 OPERATOR STATION -- A32-OS	42
<b>8.0 PID CONTROL</b>	<b>44</b>
8.1 CONTROL LOOPS	44
8.2 ADJUSTMENT OF PID CONSTANTS	52
8.3 ANALOGY OF PID CONTROL TERMINOLOGY	55
<b>9.0 SOFTWARE</b>	<b>57</b>
9.1 ANASOFT-32	57
9.2 CUSTOM APPLICATION PROGRAMS	58
<b>10.0 SOFTWARE COMMAND STRUCTURE</b>	<b>59</b>
10.1. Commands from Allen Bradley Programmable Controllers (CMD)	59
10.2. Error Checking (BCC / CRC)	59
10.3. Protocol	59
10.4. Status Codes	59
10.5. Data Table Addresses	60
10.6. Input Types	61
10.7. Output Types	61
<b>11.0 TROUBLE SHOOTING INFORMATION</b>	<b>63</b>
11.1 Computer Problems	63
11.2 Computer Software	63
11.3 Communications Problems	64
11.4 SYSTEM 32 Problems	64

## **1.0 INTRODUCTION**

The ANAFAZE SYSTEM 32 is the key element used to form an innovative measurement and control system. It combines its power with an IBM PC or similar computer to deliver an extremely efficient data acquisition and process control system. The SYSTEM 32 concentrates its power in analog measurement, independent digital loop control, alarm monitoring, and signal processing. This frees the computer to perform process control supervision including: graphic process displays, operator data entry, data printout, data storage, and process performance analysis.

The flexible ANAFAZE SYSTEM 32 is built upon a series of cost effective plug in modules to handle a variety of diverse requirements. These plug in modules make it easy to configure the SYSTEM 32 to specifically fit individual application needs. Thus a tailored system can be obtained from off the shelf modules.

The SYSTEM 32 is an excellent choice for applications where multiple inputs such as temperature, flow, speed, pressure, and others need to be measured or controlled. This is because a mixture of different sensor types can be directly connected to the SYSTEM 32. It is also well suited for processes with multiple temperature zones and control methods including cascade, ramp and soak, and adaptive control. The SYSTEM 32 is especially efficient since each controller provides independent stand-alone PID control of up to 32 process loops and up to 96 channels of data acquisition.

The result is a powerful distributed process control system with the reliability of independent loop control and the flexibility of computer supervision.

### **1.1 SYSTEM FEATURES**

**1.1.1 ACCURATE MEASUREMENT:** Every process requires accurate data measurement. The SYSTEM 32 assures this with optically-isolated input modules. Further noise rejection is achieved by an integrating measurement technique. Input to input isolation is provided with reed relay switching. This combination enables the SYSTEM 32 to deliver needed accuracy in difficult process environments.

**1.1.2 CONVENIENT INSTALLATION:** Substantial savings in wiring and installation costs can be achieved by locating SYSTEM 32 units physically near the process. This is because the communication between the SYSTEM 32 and the computer requires only four wires. A local or remote system of up to 16 units [512 loops] can be connected on a single serial line using RS-232, RS-485, or 20ma loop communication -- all optically-isolated. Larger systems may utilize multiple communication lines.

**1.1.3 PROCESS INTEGRITY:** The ANAFAZE approach delivers high integrity because the SYSTEM 32 independently controls and checks each loop for alarms while it is in turn checked by the computer. Thus a computer failure will not affect the process and a controller problem will be detected by the computer. Further integrity is built in to the SYSTEM 32 since it has EEROM memory to protect control and alarm parameters. A watchdog timer with digital output adds to process integrity.

**1.1.4 MULTIPLE TYPES OF INPUTS AND CONTROL OUTPUTS:** Since there is a large variety of processes and sensor types the system 32 has been designed to accept nearly any input and provide nearly any control output. Measurements from thermocouples, RTD's, infrared sensors, millivolt, milliamp, and other signals are directly connected the SYSTEM 32. Thermocouple reference junction compensation and linearization is done by the SYSTEM 32. With plug in input modules, 16 to 96 inputs can be accommodated in a single SYSTEM 32.

For control, each SYSTEM 32 includes, as standard, 32 digital outputs for time proportioning or on/off control. Additionally, 8 standard on/off outputs can be used for global alarm shutdowns or process warnings. Optional plug- in analog output modules provide open or closed loop control. Each module contains 16 outputs which includes both 4 to 20ma and 0 to 5Vdc outputs which can be selected individually for each output.

**1.1.5 STANDARD [ALLEN BRADLEY] COMMUNICATION PROTOCOL:** The SYSTEM 32 utilizes a form of ANSI 3.28-1976 standard protocol for communication. Jumper selection of CRC or BCC, and baud rate allow the system to matched to any host computer or other device. This ANSI standard is also used by Allen Bradley enabling the SYSTEM 32 to be connected directly to these programmable controllers.

**1.1.6 COMPACT EASILY MAINTAINED PACKAGING:** Front plug in modules with removable screw terminal blocks provide high reliability and convenient maintainability. A 3 and 6 slot housing is available and the modules require a 5Vdc power supply which can be mounted internally or externally.

## **1.2 PLUG IN SYSTEM 32 MODULES**

The flexible ANAFAZE SYSTEM 32 design allows cost effective matching of measurement and control capabilities to the process needs. By selecting a combination of plug in modules the system will perform full PID control processing, communications to a host computer, industrial sensor measurement, and deliver precise control outputs.

Configurations can start with only the PROCESSOR I/O MODULE to provide 32 time proportioning or on/off open loop control outputs. For closed loop control, simply add an ANALOG INPUT MODULE, either reed relay for 16 inputs, or solid state for 32 inputs. A plug in ANALOG OUTPUT MODULE provides 16 analog control outputs.

Systems can be matched to different applications by combining the following modules:

**1.2.1 PROCESSOR I/O MODULE:** The on board microprocessor performs all necessary control calculations, on-line analog calibration, system self test, thermocouple compensation and linearization, and communication to the host computer. This module contains the communications interface, 32 time proportioning or on/off control outputs, 24 digital outputs, and 16 digital inputs.

**Powerful Control:** The SYSTEM 32 features a digital control algorithm that allows each loop to be independently defined. Control outputs can be set for closed loop or open loop with computer setting of the output level. Switching between open loop and closed loop control can be initiated with bumpless transfer. Closed loop control modes can be selected as: on/off, proportional only [P], proportional with integral [PI], or full PID. In addition, each output can be selected as reverse [heat] or direct [cool] acting and a programmable digital output filter can be used to further match each loop to the process conditions.

**Unique Control Output Flexibility:** Total control flexibility is assured since each control output can be easily selected from the computer to match individual process needs. The unique ANAFAZE design offers: on/off, Cycle Time Proportioning, or Distributed Zero Crossing. Further flexibility is included since each output can be set as reverse or direct acting. When a process requires high power or the use of contactors, the SYSTEM 32 Cycle Time Proportioning outputs are automatically balanced to minimize the peak power consumption. For processes with solid-state power switching, the Distributed Zero Crossing outputs provide the smoothest application of control power.

**Open Heater Detection:** The SYSTEM 32 measures the current flowing in each heater or other time proportioning output circuit to ensure that open heaters and stuck relays are detected.

**Protected Memory:** Setpoints and other control parameters entered from the computer are stored in non-volatile memory eliminating the need to re-enter these parameters after a power failure.

**Communication Monitor:** A communications monitor can be enabled that will turn off all control outputs after a selectable time period if no communication is received from the host computer.



**1.2.2 ANALOG INPUT MODULES:** Two optically-isolated analog input modules are available for the SYSTEM 32. A 16 channel reed relay switching module and a 32 channel solid state switching module. The reed relay module provides the highest level of input noise protection and the solid state module is more economical. The two types of input modules can be mixed in a single controller. Allowing up to 48 channels of reed relay inputs, 96 channels of solid state inputs, or any combination such as 32 reed relay inputs with 32 solid state inputs. Both modules offer direct connection of industrial sensors including thermocouples, RTD's, infrared sensors, milliamp, and millivolt signals.

**1.2.3 PULSE INPUT MODULE:** Allows measurement of speed, RPM, flow, and other inputs from sensor that produce pulse outputs. Each module accepts up to 32 inputs and optical- isolation can be optionally added where necessary. The pulse input module requires an expanded PROCESSOR I/O MODULE, please contact ANAFAZE for additional information.

**1.2.4 ANALOG OUTPUT MODULE:** Provides 16 analog outputs for open or closed loop control. Both 4 to 20ma and 0 to 5vdc are available for each output [select one].

**1.2.5 HOUSING:** provides fully enclosed mounting for all modules and includes a passive [no electrical components] interconnecting backplane. A 3 and 6 slot housing is offered. The 6 slot housing can be mounted in standard relay racks. The six slot housing is 19" wide, 12.25" high, and only 7.5" deep. The 3 slot housing is 10 5/8" wide, 12.25" high, and 7.5" deep.

**1.2.6 POWER SUPPLY:** All the SYSTEM 32 modules operate from this 5vdc power supply. The power supply is furnished mounted to a standard module front panel and occupies one slot in the housing. If desired the power supply can be removed from the panel and externally mounted. This frees the slot for an other module. The power supply connects to terminals on the passive backplane.

### **1.3 ANASOFT 32 -- POWERFUL OPERATING SOFTWARE**

Whether the process is simple or complex it must be defined and set up in order to control it. Therefore, another essential element of a successful measurement and control system is the application software. ANASOFT 32 is sophisticated menu driven software program for the SYSTEM 32 that runs on IBM PC and compatible computers. It is designed to be easily operated by inexperienced computer users and it offers full flexibility for complex applications.

**1.3.1 GRAPHIC PROCESS DISPLAYS:** ANASOFT features a process monitor screen that provides an overview of the system status at a glance. Measured data can be displayed in either a graphic or numeric mode. On

line, real-time data for each input can be graphically plotted on the screen. Data is continuously stored for every input to provide a history over user selected time intervals. These on line plots enable quick analysis of process conditions for optimizing performance, tuning control loops, determining reasons for alarms, and other situations.

**1.3.2 TUNING AND PROCESS SET UP:** The password protected tune menu displays necessary data for efficient tuning since it displays real time process information. Key selectable sub menus are used to enter control parameters, input scaling, trend plot scaling and time interval, warning levels, and alarm setpoints.

**1.3.3 DATA LOGGING:** Hardcopy data is essential for record keeping, quality control, required agency reporting, and production reports. ANASOFT offers both automatic printer data logging, and disk data logging in LOTUS compatible files. An available option for data recording when the computer is not on line is the on-board memory option. This is 28.8k Bytes of RAM memory for each A32-PIOM module in the system.

**1.3.4 SYSTEM EXPANSION:** ANAFAZE can provide complete turn key systems for advanced control applications. Ramp and soak, adaptive control, cascade control, and other types of systems can be designed and installed by ANAFAZE engineering. Since many applications can be based on ANASOFT, the cost and the time period for implementation is reduced. ANASOFT is written in Microsoft QUICKBASIC and the source code is provided for users that want to make their own modifications.

## 2.0 SPECIFICATIONS

### 2.1 ANALOG INPUTS

Number of channels:	32 for PID control, 48 total with reed multiplexer, 96 total with solid state.
Multiplexing:	three wire reed relay, guarded inputs. two wire solid state.
A/D converter:	integrating voltage to frequency.
Loop update:	each loop 2 times per second, reed modules; 1 time per second solid state.
Input isolation:	optical coupling.
Input resolution:	0.02% full scale [Approximately 12.7uv].
Temp. coefficient:	.005% per degree.
Measurement accuracy:	$\pm 0.1\%$ full scale.
Thermocouple break:	up scale standard.
Standard input types:	All are present in every system: select by command from host, any order, any mix:
Thermocouple ranges: [200 ohms max.]	J: -350 to 1400 F    K: -450 to 2500 F T: -450 to 750 F    E: -450 to 1450 F R: 0 to 3200 F    S: 0 to 3200 F SYSTEM 32 must be operating between 0 and 50 degrees C for full T/C ranges.
Thermocouple scaling:	Degrees F [convert to degrees C in computer].
Other Inputs:	-10mv to 60mv input range with provision for scaling resistors and bridges for Voltage/Current and RTD inputs.
Linear Scaling:	-16.7% to 100% for -10 to 60 mv
Voltage Ranges: 100v max:	Select resistors for 0 to 10v, 0 to 5v, 2 to 10v, etc. as required.
Current Ranges:	Select resistors for 0 to 10ma, 4 to 20ma, 10 to 50ma, etc. as required.
Bridge Excitation:	10v $\pm$ .13%, at 50ma max [temperature coefficient 15ppm/degree C max].
Optional input types:	Other T/C types, Non-contact infrared, 2, 3, or 4-wire RTD, Carbon Potential.

## 2.2 OPERATING PARAMETERS

Independently set for each loop through serial interface.

Input type:	any standard type (see above), any mix.
Gain:	0 to 255 proportional; 0 to 510 on/off. Proportional Band: Direct reading in engineering units of the loop range.
Integral:	0 to 1020 seconds. Reset: .05 to 60 Repeats/Min. [4 sec. resolution].
Derivative:	0 to 255 sec. Rate: .01 to 4.25 Min.
Digital Filter:	Averages last 0 to 255 outputs. [0- 127.5 sec. time constant].
Setpoint:	$\pm$ span. Resolution: 0.01%; $0.1^{\circ}$ for T/C. ANASOFT resolution: 0.1%; $1^{\circ}$ for T/C.
Deviation band alarm:	0 to $\pm 25\%$ Full Scale; 0 to $\pm 250^{\circ}$ T/C.
Control output level:	Direct or reverse acting, 0-100%.
Manual output:	0 to 100% (0.4% resolution).

## 2.3 REPORTING PARAMETERS

The computer can request any of the following for any loop:

Operating parameters:	all of the above
Analog inputs:	measured values
Digital I/O:	status

## 2.4 COMMUNICATIONS

Types:	RS-232 or 20ma current loop, factory set; optional RS422 or RS485
Baud rate:	2400 or 9600, switch selectable
Protocol:	Form of ANSI X3.28-1976 [Allen Bradley compatible]
Character set:	ANSI X3.4
Error check:	CRC or BCC, switch selectable.
Isolation:	optical for all types including RS-232.
Display:	LED indicates communication active.

## 2.5 CONTROL AND ALARM OUTPUTS

32 Individually selectable control outputs:

Digital Outputs: Time proportioning, On/Off, Alarms: voltage output: 5VDC at 6ma maximum for solid state or other relays.

Analog: voltage or current: selectable (4 to 20ma, or 0 to 5 volts).

## 2.6 DIGITAL INPUT OR OUTPUT

24 DigitalOutputs: TTL Level: true= < 0.4v @ 6ma false => 3.9v @ 6ma

16 Digital Inputs: TTL Level:

## 2.7 ANALOG OUTPUTS

Types: 0 to 5Vdc at 5ma max.  
4-20ma at 8Vdc max [maximum loop impedance 400 ohms].

Both are available at the output terminals of each output. Either can be used -- no jumpers are required. DO NOT USE BOTH ON SAME OUTPUT.

Accuracy: +3%

Resolution: 0.4%

## 2.8 GENERAL

Power input: 120VAC, 60Hz, to power supply.  
modules require 5vdc @ 5A max [6 slot].

Operating ambient: 0 to 50 C.

Humidity: 10% to 90%, non-condensing.

Enclosures: NEMA 4, 12, 13 and others optional.

Physical: 6 Slot Housing: 16.7" wide [19" standard rack mount], 12.5" high, 7.5" deep.  
3 Slot Housing: 10.7" wide.

Mounting: 4 mounting holes for standard rack or panel mounting -- see outline drawings.

Weight: maximum 20 pounds depends on plug modules selected.

## 2.9 SUBASSEMBLY IDENTIFICATION

**A32-PIOM:** PROCESSOR I/O MODULE includes factory selectable communication interface [RS-232 or current loop], 32 control outputs, 24 digital outputs, and 16 digital inputs.

**A32-RRAIM:** REED RELAY ANALOG INPUT MODULE for 16 mixed sensor inputs including direct connection of thermocouples [J, K, or T] or millivolt [-5 to 60mv]. Includes reference junction sensors for thermocouple inputs.

**A32-SSAIM:** SOLID STATE ANALOG INPUT MODULE for 32 mixed analog inputs including direct connection of thermocouple or millivolt inputs. Includes reference junction sensors for thermocouple inputs.

**A32-IAIM-SIXX:** SPECIAL INPUT SCALING for RRAIM or SSAIM to connect milliamp, voltage, or RTD inputs. Consult ANAFAZE for details.

**A32-AOM :** ANALOG OUTPUT MODULE with 16 analog outputs set for both 0 to 5Vdc and 4 to 20ma. Consult ANAFAZE for other output levels.

**A32-H6:** 6 SLOT HOUSING including passive interconnection backplane and up to three blank front panels. Can be mounted on a panel or in a standard 19 rack [12.5" high, 19"wide, 7.5"deep].

**A32-H3:** 3 SLOT HOUSING including passive backplane and up to one blank front panel. For panel mounting 12.5" high, 10.7" wide and 7.5" deep.

**A32-PS:** POWER SUPPLY: mounted on a blank front panel with wiring to passive backplane. Supply can be externally mounted or plugged into a module slot. Dimensions: 9" high, 2" wide and 5" deep.

**A32-OS:** OPERATOR STATION: allows for data display and setpoint entry away from the system computer [requires ANASOFT].

**ANASOFT-32:** Software operating system for IBM PC and compatible computers.

**CABLES:** Interconnection cables with an RS-232 connector on one end and wires at other for connection to SYSTEM 32 terminals:

CA-232M	25' RS-232 cable male computer connector
CA-232F	25' RS-232 cable female computer connector

### 3.0 INSTALLATION

There are some precautions that must be observed when installing SYSTEM 32:

**WARNING: ELECTRICAL SHOCK DANGER**

**It is very important that all system power including the power input be disconnected before servicing the ANAFAZE SYSTEM 32. HIGH VOLTAGE MAY BE PRESENT EVEN WHEN POWER IS TURNED OFF.**

**To reduce the danger of electrical shock always mount the SYSTEM 32 in an enclosure that prevents personnel contact.**

Since the ANAFAZE SYSTEM 32 can make measurements of input signals that are not referenced to ground, the SYSTEM 32 ground and other signal lines can have power line or other high voltage present even if the input power is turned off. This could happen, for example, if a thermocouple was inadvertently shorted to the AC power line.

**WARNING: USE CORRECT INSULATION TRIM LENGTH AND WIRE GAGE**

**The correct insulation trim length is 1/4" or 5mm. Care must be taken to prevent contact between any wires and the case which is grounded. The terminal manufacturer has UL approval for #14 to #30 AWG (American Wire Gage). ANAFAZE recommends using #18 or #20 AWG.**

To effectively use the plug-in terminals, the wire insulation should be trimmed so that the wire fits inside the terminal with no bare wire exposed. Stranded wire should be tinned.

**WARNING: SUPPORT CABLES**

**Power, input, and output cables should be supported to reduce strain on the connectors and to prevent them from being pulled out of the terminal strips.**



### 3.1 PHYSICAL CONSIDERATIONS

The ANAFAZE SYSTEM 32 consists of a number of plug in modules for a housing with a passive backplane. Three or six slots are provided for plug-in option boards.

#### 3.1.1 MOUNTING [SEE DIAGRAMS ON NEXT 3 PAGES]



For optimum performance when directly connecting thermocouple inputs the unit should be protected from thermal shocks whenever possible. This will minimize any temperature gradients across the terminal strips and result in the highest accuracy.

# 6 SLOT HOUSING DIMENSIONS

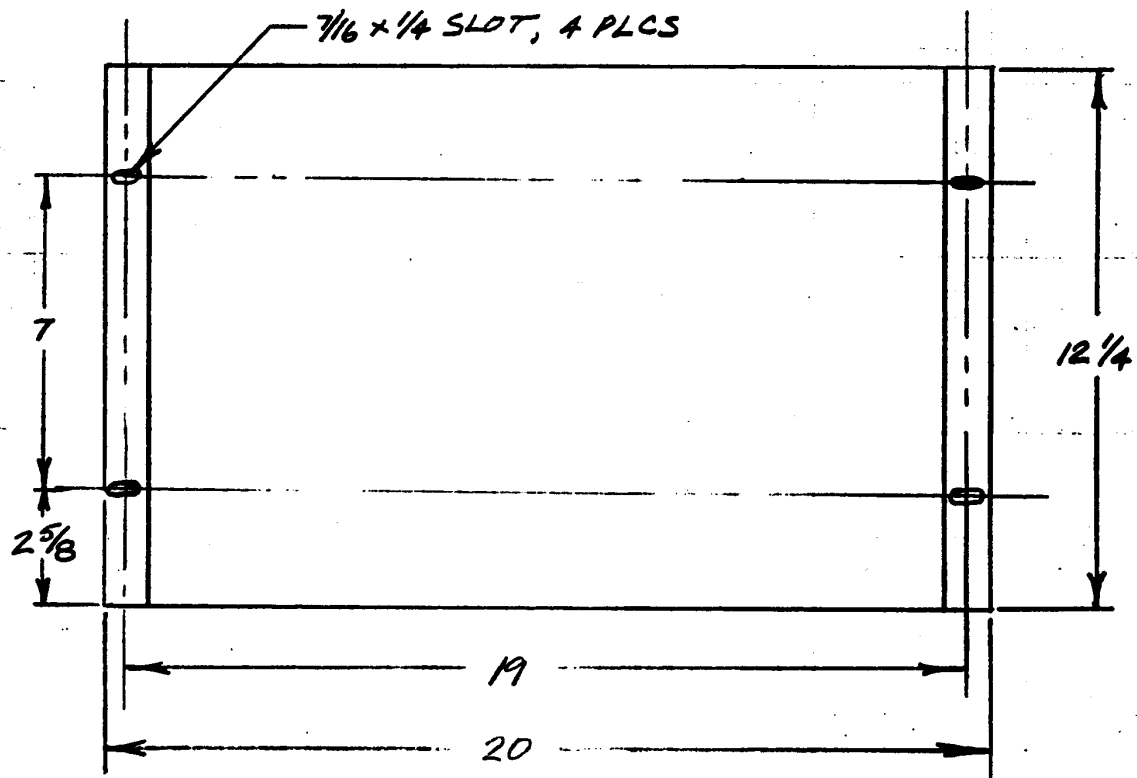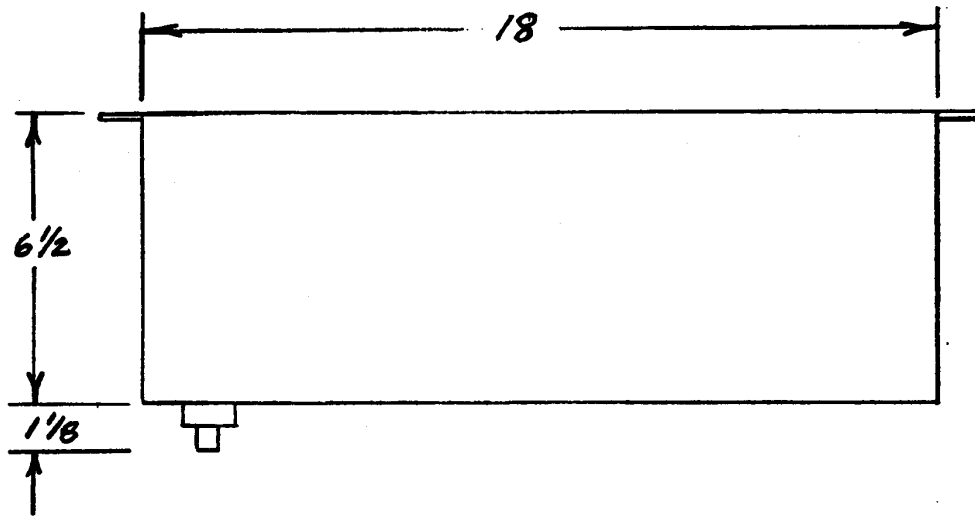




### 3 SLOT HOUSING DIMENSIONS

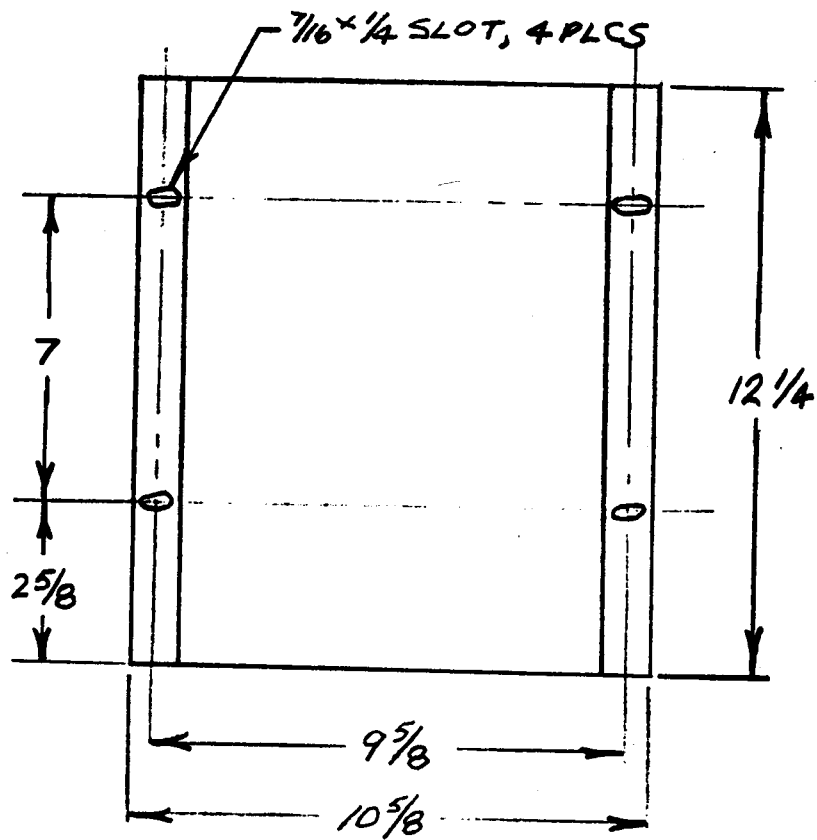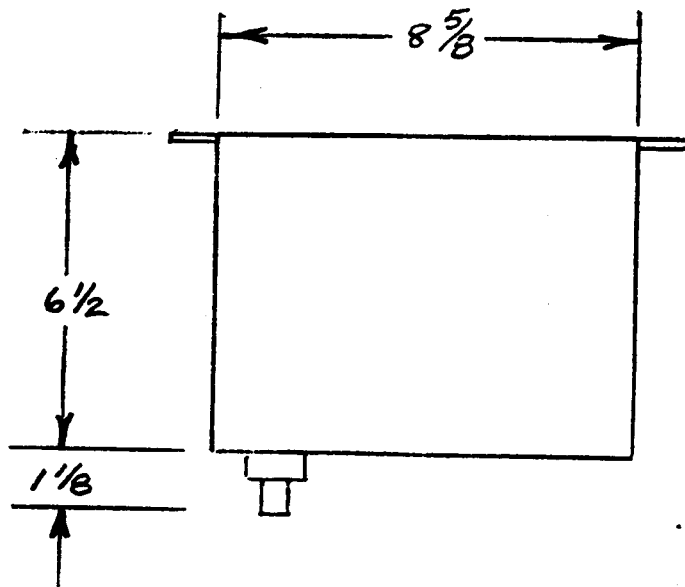

# POWER SUPPLY DIMENSIONS

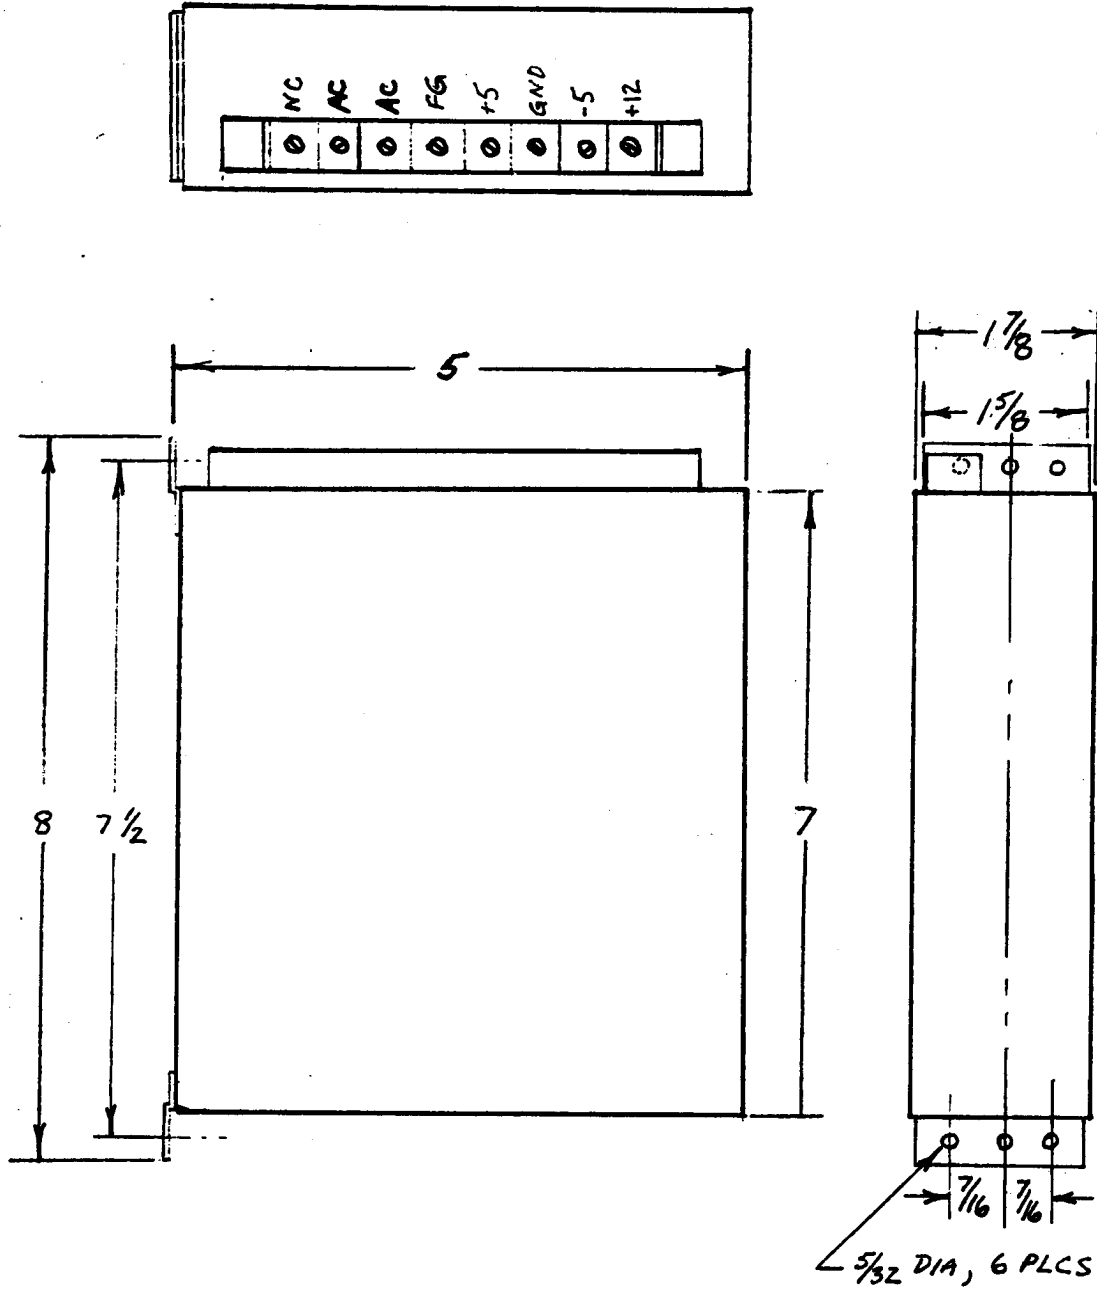

### 3.1.3 DETACHABLE TERMINAL BLOCKS

#### WARNING - ALWAYS CHECK TERMINAL LOCATION AND ORIENTATION

All connections, except the Ac power supply, are made on removable terminal strips. Terminal strip removal is achieved by removing the retaining screws and pulling them directly away from the front panel. The terminal strips must be carefully installed in the correct position and not up side down.

### 3.2 CONFIGURATION

#### WARNING - TURN OFF POWER BEFORE CHANGING SWITCH

The unit configuration switch is located on the A32-PIOM PROCESSOR I/O MODULE. It is a eight position DIP switch which is used to set the unit station number, the baud rate, and the communications check character. The functions are:

1	2	3	4	5	6	7	8	
1	1	1	1	COMM	9600	CRC	NOT	ON = 1
0	0	0	0	Check	2400	BCC	USED	OFF = 0
Station Number								

#### 3.2.1. STATION NUMBER (STN)

Four bit switches (Switch 1 - Switch 4) are provided on the SYSTEM 32 to select controller addresses. These are read in hex format providing 16 addresses, 0000 to 1111. The base Station Number is 08 and the bit switches select an address above that. Setting the bit switch in the on position is considered a one by the processor.

Switch Number	Hex Address	Octal Address	Controller
4 3 2 1			
Settings			
0 0 0 0 [all off]	08	010	1
0 0 0 1	09	011	2
0 0 1 0	0A	012	3
0 0 1 1	0B	013	4
0 1 0 0	0C	014	5
0 1 0 1	0D	015	6
0 1 1 0	0E	016	7
0 1 1 1	0F	017	8
1 0 0 0	10	020	9
1 0 0 1	11	021	10
1 0 1 0	12	022	11
1 0 1 1	13	023	12
1 1 0 0	14	024	13
1 1 0 1	15	025	14
1 1 1 0	16	026	15
1 1 1 1 [all on]	17	027	16

### 3.2.2 COMMUNICATIONS WATCHDOG TIMER

The communications timer provides a method of turning off all control outputs if there is a problem in the host computer that effects communication. It operates by monitoring activity on the communication line. If this controller has not been contacted within the time interval, it automatically sets all control outputs to manual with zero outputs. A dedicated digital output is set when the watchdog times out.

**WARNING: IF THE COMMUNICATIONS WATCHDOG IS ENABLED, INSURE THAT THE HOST COMPUTER COMMUNICATES WITH EACH SYSTEM 32 WITH IN THE TIME LIMIT. IF NOT THE CONTROL OUTPUTS WILL BE SET TO MANUAL WITH ZERO OUTPUT.**

Switch Setting	Watchdog Status
On	Enabled
Off	Disabled

The hardware bit switch number 5 must be set to the "ON" position to enable the communications watchdog timer. If the switch is ON at startup then the controller constantly monitors the elapsed time between host communication packets and takes action should the elapsed time overflow the preset timeout period.

Furthermore, the option may be disabled by the host. If a value of -1 is written into the timeout period counter then the controller disables the option and ceases to monitor elapsed time. To re-enable the option via software, the host must rewrite a valid timeout period to the watchdog counter.

#### **Timeout Period**

The host computer may adjust the timeout period value within the range of 1 to 1092 seconds (or 18.2 minutes) with a resolution of one second. A 2-byte number representing the length of the timeout period in seconds can be written to the controller data table addresses 0290 and 0291 Hex.

The default timeout period (set by the controller on startup/reset) is 2 minutes (120 seconds).

#### **Controller Action on Timeout**

If the watchdog option is enabled and the elapsed time between communication packets from the host exceeds the set timeout period, the controller initiates a communications alarm sequence. This sequence involves the following :

1. All control output types are set to MANUAL
2. All output values for control outputs are set to 0%.
3. Digital output 72 is set ON. This output is available at TB2, pin 30.
4. The internal controller reset flag is set TRUE. (Hence the host will receive a RESET status code upon re-establishing communication).

### 3.2.3 BAUD RATE SELECTION

Switch 6 is used to set the baud rate at either 2400 or 9600. If communication problems occur try 2400 baud.

Switch Setting	Baud Rate
0	2400
1	9600

### 3.2.4 ERROR CHECKING

Switch 7 is used to select the method of error that is used by the SYSTEM 32. BCC is slightly faster and can be used for most applications. CRC provides the highest data integrity and is recommended if communications problems are noted.

Switch Setting	Error Check
0	BCC
1	CRC

## 3.3 AC POWER INPUT

The ANAFAZE 32 PID requires 120VAC at 60Hz for power input to the power supply. The power supply can be mounted to a module panel or externally if desired.

### 3.3.1 POWER CONNECTIONS

The power must be connected according to the terminal labels. The abbreviations are:

FG	Third wire ground -- normally Green wire
NEU	110VAC Neutral -- normally white wire
HOT	110VAC Hot -- normally black wire
+5	+5Vdc input on back plane
GND	GND on backplane

**WARNING: DO NOT REVERSE THE +5 AND GND CONNECTIONS IRREVERSIBLE DAMAGE TO THE 32 SYSTEM WILL OCCUR**

### 3.3.2 POWER FUSE

The SYSTEM 32 power supply is not fused. An external 1/2 AMP fuse in the AC input line is recommended.

## 4.0 COMMUNICATIONS SET-UP AND CONNECTIONS

The ANAFAZE SYSTEM 32 is designed for three types of serial communications: RS-232, RS-485, and 20ma current loop. Up to 16 units can be connected on one communication line.

### 4.1 RS-232

The optically-isolated RS-232 interface is located on the processor module A32-PIOM. Multiple SYSTEM 32 units are connected in parallel. Connections are made on the upper terminal block TB1 as follows:

Computer	SYSTEM 32 [1] TB1	SYSTEM 32 [2] TB1
RX #3 -----	TX- #2 -----	TX- #2
TX #2 -----	RX+ #3 -----	RX+ #3
GND #7 -----	RX- #4 -----	RX- #4

The computer pins are for the normal 25 pin RS-232 connector. On some computers transmit TX and receive RX may be reversed. Please check your computer manual for details.

The ANAFAZE SYSTEM 32 RS-232 interface transmits data on TX- and receives data on RX+. The host computer TXD output should be connected to the SYSTEM 32 RX+ input. The SYSTEM 32 TX- output should be connected to the host computer RXD input. Host computer communication ground should be connected to the SYSTEM 32 RX-.

Multiple SYSTEM 32 units are connected on the RS-232 line in parallel. The SYSTEM 32 nearest to the computer is connected as described above. Then each SYSTEM 32 is daisy chained wire for wire to the next unit. The next units' TX- is connected to the first units' TX-, RX+ to RX+, and RX- to RX- etc.

### **WARNING: REMOVE JUMPER FOR MULTIPLE SYSTEM 32 INSTALLATIONS**

**Jumper JU18 must be removed on all but the farthest unit from the computer when multiple units are on the same communications line.**

### 4.1.1 Other RS-232 Lines

Some host computers or other RS-232 devices use additional communication lines that are not required by the SYSTEM 32. These include:


RTS - Ready to Send	DSR - Data Set Ready
CTS - Clear To Send	DTR - Data Terminal Ready

If the host computer uses RTS and CTS or DSR and DTR, these lines should be connected together in pairs [or as shown in the computer manual]. Normally this is done in the RS-232 connector hood at the host computer. Alternately the effect of these lines can be eliminated in software. The ANAFAZE SYSTEM 32 is ready to receive data; therefore these lines are not required.


### 4.2 CURRENT LOOP

The current loop interface is located on the processor module A32-PIOM. Current loop is recommended for longer cable runs and noisy environments. The ANAFAZE SYSTEM 32 current loop is optically isolated. It uses an external power supply for the current loop which is normally included in the device communicating with the SYSTEM 32. Consult ANAFAZE for recommendations.

SINGLE UNIT:

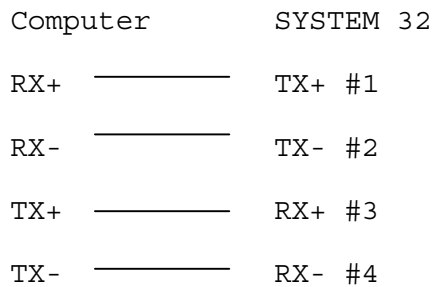

MULTIPLE UNITS:

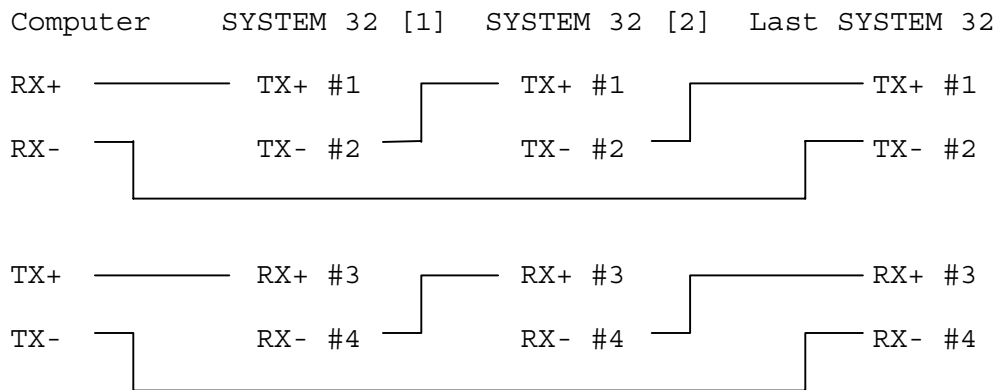

Multiple SYSTEM 32 units are connected in series. R+ is connected to the first unit TX+ and TX- from the first unit is connected to TX+ of the next unit. These serial connections are continued until the last unit is reached. The last unit TX- is connected to the computer R-. T+ is connected to the first unit RX+ and the RX- is connected to the next unit RX+. The last unit RX- is connected to the computer T-.

### **4.3 RS-485**

The RS-485 is a voltage balance long distance multi-point transmission interface. It may use 2 or 4 lines depending on system requirements.

#### **4.3.1 RS-485 Description**

The EIA Standard RS-485 specifies only the electrical characteristics of generators (transmitters) and receivers for use in digital multi-point systems. The specification of transmission lines, signaling rates, protocols, etc. is left entirely up to the user. The transmitters and receivers selected by Anafaze also meet the requirements of RS-422.

The following information is intended to make recommendations for the application of the RS-485 interface to Anafaze equipment. This note covers 4 wire communication. Anafaze equipment will also support 2 wire communication. Please contact the factory for recommendations.

The maximum signaling rate used by the Anafaze System 32 and associated equipment is 9600 baud. Since this is far below the maximum signaling rate covered by the specification, satisfactory performance may be expected without strict adherence to all of the design rules. ANAFAZE has presented conservative recommendations to insure reliable operation. If deviations are necessary, please contact ANAFAZE.

#### **4.3.2 Cable Selection**

ANAFAZE recommends twisted shielded pairs for the RS-485 cables. The transmitters and receivers specified in RS-485 are very tolerant of cable characteristics, and some leeway is possible unless distances and signaling rates push the specification limits.

One requirement is very important, as it impacts performance even down to low frequency operation. The loop resistance of the transmission line [wire only -- not terminating resistor] must not exceed 200 ohms for a properly terminated line with a reasonable margin for noise. Thus the following recommendations for distance and wire gauge should be observed:



<b>Distance</b>	<b>Wire Gauge</b>	<b>Recommended Cable</b>
1500 ft.	28 AWG	Alpha 3492
4000 ft.	24 AWG	Beldon 9729
6000 ft.	22 AWG	Beldon 9184

The use of a shield depends on the noise environment and grounding considerations [4.3.3]. The above cables are shielded.

### **4.3.3 Connections**

Connection of the Anafaze controllers to a system computer requires an interface at the computer to convert RS-232 levels to RS-485. Anafaze recommends Black Box Model LD485A for this purpose. The LD485A should be configured for DCE operation, with the RTS/CTS delay jumper in the "on" position.

The RS-485 specification is for "balanced line" operation, and is not true differential. Thus a common connection is required between all stations on the communication line. This can be accomplished by either a 5th wire (which could be shield) or a common ground connection. The Anafaze system more conveniently supports the common ground connection, although 5th wire can be supported if required due to common mode voltages generated in a given installation. The 5th wire connection would be required only if the "common mode" voltage between stations exceeds the RS-485 specification of 7 volts peak. The power common in the Anafaze controller has been wired to chassis ground. To make sure the communication system works, the controller chassis must be electrically tied to Earth ground, and the host computer communication must be tied to Earth ground. If the host computer RS-232 communication is not referenced to Earth ground, then install the 100 ohm resistor in W7 as recommended by Black Box.


Figure 1 shows the only recommended system hookup. (Other hookups may work fine). The transmitter from the host computer connects in parallel to the controller receivers, and the host computer receiver hooks in parallel to the controller transmitters. A single "daisy chain" is recommended. Octopus connections or "spurs" are discouraged. A termination resistor is required at each end of the transmission line. This is accomplished by applying a 200 ohm resistor across the line at the farthest point from the computer transmitter, and by setting the Black Box SW2 to the "term" position to terminate the computer receive line.

ANAFAZE SYSTEM 32 connections for a single unit are as follows:

COMPUTER	Black Box LD485A	SYSTEM 32
+485 Output (Start bit +5v)	TXA	RX+ #3
-485 Output (Start bit 0v)	TXB	RX- #4
+485 Input	RXA	TX+ #1
-485 Input	RXB	TX- #2
Shield-----Earth Ground-----Shield		Do not Ground

Note: Connect the shields to earth ground only at the computer or other 485 interface. No shield connection is required at the SYSTEM 32. **Connect a 200 ohm terminating resistor between RX- and RX+ at the SYSTEM 32.**

For multiple units connect the system as follows:

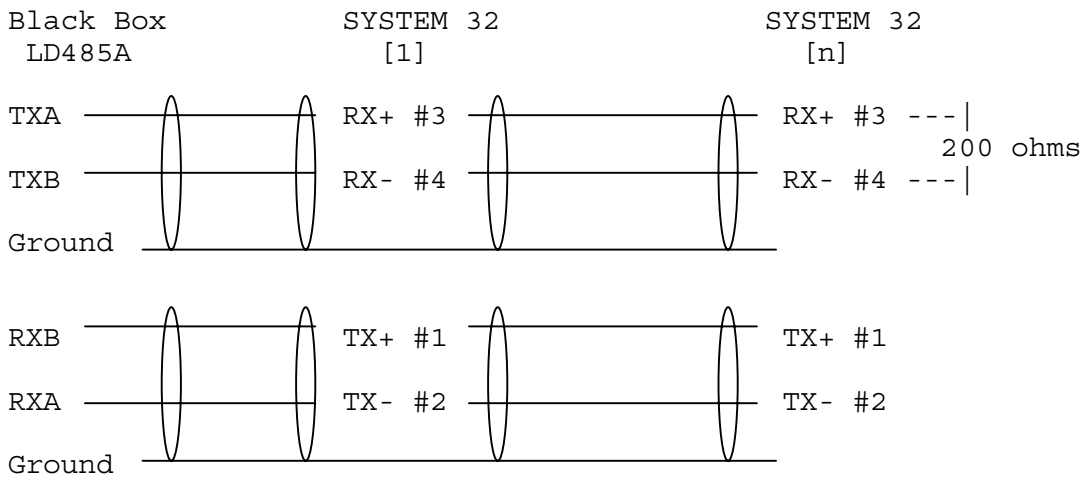

## **5.0 ANALOG INPUTS**

Connecting analog signals to the ANAFAZE SYSTEM 32 is normally straightforward. Most signals, including thermocouples can be directly connected and mixed in any order. However, some problems may occur that could reduce accuracy and possibly damage the unit. Sections 5.1 through 5.4 indicate some of the potential areas for concern. [See typical input DIAGRAM in section 5.13].

### **5.1 COMMON MODE VOLTAGE**

Common mode voltage is the voltage between the ground at the sensor and the ground at the ANAFAZE SYSTEM 32. It can be an AC or DC voltage and appears equally at the high and low input terminals. Frequently it is caused by large currents flowing in the ground path between the SYSTEM 32 and the sensors. The effects are minimized by locating the SYSTEM 32 as close as possible to the sensors. Do not exceed the maximum common mode voltage of 150 volts AC.

### **5.2 NORMAL MODE VOLTAGE**

Normal mode voltage appears across the terminals of the input and is the signal from the sensor plus any undesirable noise. The major cause of this noise is AC power line pick-up. The effects are reduced by the ANAFAZE SYSTEM 32 capacity to integrate the signal over a multiple of the power line frequency. Further reduction can be achieved by locating the SYSTEM 32 near the sensors and by using twisted and shielded sensor wires. To ensure accurate readings, the maximum of normal mode plus signal should not exceed -10mv to +65mv.

### **5.3 GROUNDING**

For best accuracy, observe the grounding recommendations for connecting each input and output signal. The analog signal grounds should be connected to the low terminals on the analog input terminals. The communication and control outputs should also be connected with their respective grounds. Do not mix the grounds or connect them together. The analog input section is optically isolated from the processing and control section. Connecting the grounds together will negate this feature and could damage the unit. If possible, route the analog signal cables separately from the communication, control and power cables.

### **5.4 SOURCE IMPEDANCE**

Each sensor has a certain output impedance which is effectively connected across the ANAFAZE SYSTEM 32 input amplifier when a measurement is made. To reach the rated accuracy, the maximum source impedance should not exceed 300 ohms. Consult ANAFAZE for operation with higher source impedance.

## 5.5 ANALOG INPUT MODULES

Two types of analog input modules are available for the SYSTEM 32. The A32-RRIAM -- REED RELAY ANALOG INPUT MODULE provides 16 analog inputs with reed relay switching. The A32-SSAIM -- SOLID STATE ANALOG INPUT MODULE provides 32 inputs with solid state switching. The A32-SSAIM also provides 32 digital outputs for special systems. The primary differences are:

The REED RELAY ANALOG INPUT MODULE provides 250Vdc isolation between input channels and three wire switching: high, low, and shield for each input. This module allows connection of three and four wire RTD's and other special sensors. The REED RELAY ANALOG INPUT MODULE is also recommended where high noise is present or where grounded sensors are used and the ground potential difference will exceed 10 Vdc.


The SOLID STATE ANALOG INPUT MODULE provides 32 inputs and includes a high and low switch for each channel. The solid state switching limits the channel to channel protection to 15Vdc. The SOLID STATE ANALOG INPUT MODULE should be used with un-grounded sensors, or sensors with the same ground potential [with-in 10Vdc].

## 5.6 A32-RRIAM -- REED RELAY ANALOG INPUT MODULE

The A32-RRIAM includes 16 analog inputs and a reference power supply. The module can be plugged into any housing slot.

### 5.6.1 INPUT CIRCUITS

The ANAFAZE A32-RRIAM contains an isolated area that can be used to install resistors to scale input voltages and connect inputs to match the -10 to 60mv (-16.7% to 100%) input range. The input circuit is designed to enable connection of current inputs (such as 4 to 20ma), voltage inputs, and for connection of transducers (RTD) in bridge configurations. ANAFAZE will supply input scaling as needed -- order option A32-SI-XX. The input circuit is shown below:

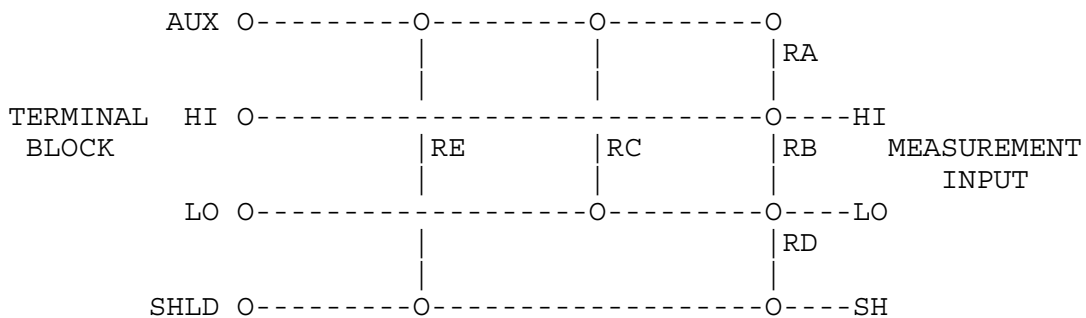

RA, RB, RC, RD and RE are selected separately for each input and are labeled on the PC board for each loop. CH 1 (channel 1) is loop 1 etc. Resistors should be 0.1% metal film, 1/4 watt. Other components such as

capacitors can be installed for signal conditioning. Please consult ANAFAZE. The PC board silk screen shows the resistor locations.

### 5.6.2 USE OF THE SHIELD CONNECTION

The shield connection provides a third input which is switched as each channel is measured. It is the ground reference for the measurement section. By switching this reference with every channel, the effective measurement ground can float to match the ground at the sensor, thus greatly reducing the error caused by different ground potentials (common mode).

The system is factory set for use with non-shielded cables. Zero ohm resistors in the RD position connect each low input to shield. Normally when non-shielded cables are used, this will result in the lowest noise pick-up.

If shielded cables are used, the shield should be connected to ground or the low signal output at the sensor if possible. If this is done, the RD resistor for that channel must be removed.

#### **WARNING - USE SHIELD CORRECTLY**

**If the shield is used for any input always remove the factory installed RD resistor.**

### 5.6.3 VOLTAGE INPUTS

DC Voltage inputs should be connected with the positive side to the HIGH terminal and the negative side to the LOW terminal. The input range is -10 to +60 mv. Signals greater than 60 mv must be scaled with resistors to match the input full scale to 60 mv. For scaling the positive input should be connected to the AUX terminal and the negative input to the LOW terminal. The scaling resistor RA is selected as the voltage dropping and/or current limiting resistor. RB is selected for the 60 mv full scale dropping resistor. It should normally be less than 300 ohms and should never be greater than 1000 ohms. Any value above 1000 ohms for RB will cause error due to the upscale burnout circuit. Typical standard value scaling resistors are as follows:

	0-100mv	0-500mv	0-1v	0-5v	0-10v
RA=	499 ohms	5.49k	6.91k	39.2k	49.9k
RB=	750 ohms	750 ohms	442 ohms	475 ohms	301 ohms
ACC.=	+ .1%	+ .1%	+ .2%	- .2%	- .1%

Please note section 5.6.2 regarding the shield connection.

Please note section 5.8 regarding scaling and calibration.

The above values are standard metal film values and will give an accuracy of +/- .25% when using .1% tolerance resistors.

Any possible error due to resistor tolerance may be corrected by using scaling in ANASOFT.

### 5.6.4 DC CURRENT INPUTS

Current inputs from transmitters are accommodated by placing resistors in the input section to convert the current input into a voltage. Different current input ranges are accommodated by selecting the proper resistor values. In general RC is selected to maintain a low source resistance. RA and RC produce the input full scale of 60mv. **The positive input should be connected to the AUX terminal, and the negative input to the LOW terminal.** The following input values are suggested:

4 to 20 ma	0 to 10 ma
RA = 93.1 ohms	RA = 26.7 ohms
RB = 20.0 ohms	RB = 20.0 ohms
RC = 20.0 ohms	RC = 20.0 ohms
Load resistance=17 ohms	Load Resistance=14 ohms

A single 0.1% resistor may be used in place of the above resistors although a small error may occur. This error can be corrected in using the scaling in ANASOFT.

4 to 20 ma	0 to 10 ma
RB = 3.000 ohms	RB = 6.000 ohms
Please note section 5.6.2 regarding the shield connection.	
Please note section 5.8 regarding scaling and calibration.	

### 5.6.5 THERMOCOUPLE INPUTS

All thermocouple types may be directly connected to the ANAFAZE SYSTEM 32. Types J,K,T,R,S,C, and B linearization and cold junction compensation are provided standard in the ANAFAZE SYSTEM 32. For other thermocouple types, optional input ranges are required. Thermocouples should be connected with the positive lead to the HIGH terminal and the negative lead to the LOW terminal. Note section 4.5 on shielding.

### 5.6.6 RTD INPUTS

RTD's can be connected in different configurations including bridge circuits, three wire and four wire -- please request a copy of the ANAFAZE RTD application bulletin.

The standard industrial RTD is a 100 ohm Platinum three wire assembly. THE ANAFAZE SYSTEM 32 WILL BE CONFIGURED FOR THE STANDARD THREE WIRE RTD INPUT UNLESS OTHERWISE SPECIFIED.

ANAFAZE recommends using only the 3-wire or 4-wire RTD configuration for high accuracy.

Due to multiple ranges, different RTD range resistors, and special linearization of the RTD range for high accuracy, the RTD INPUT should be factory installed. If less accuracy is acceptable, please request the ANAFAZE RTD application bulletin to field install the RTD input.

### 5.6.7 INFRARED NON-CONTACT TEMPERATURE SENSORS

The ANAFAZE IRSM infrared sensing module is ideally suited for many infrared non-contact temperature applications. It can be supplied by ANAFAZE as a fully integrated system with the SYSTEM 32 configured to provide power for up to four IRSM sensing modules and for direct connection of the IRSM output.

The following connections are required if the IRSM internal ambient sensor is not used:

ANAFAZE SYSTEM 32	Pin	IRSM WIRES Color	Function
AUX -----	A	Orange	Signal out
HIGH -- no connection --			[0-10madc]
LOW -----	B	White	Signal ground
SHLD -----	K	Shield	Shield
No connection	E	Red	+5vdc supply
REF GND -----	C	Black	power ground
REF GND -----	J	Brown	no peak hold
+ REF -----	D	Green	+15vdc supply
No connection	F	Blue	Ambient sensor
No connection	H	Yellow	Track and hold

The range of the standard IRSM is 0-1000 degrees F with an output of 0-10madc. The input of the ANAFAZE SYSTEM 32 configured for a 0-10madc input. See section 5.6.4

To use more than the factory installed four IRSM with the SYSTEM 32, use an external power supply of 8-15vdc.

If desired a second input can be used to monitor the IRSM internal ambient temperature. Please consult ANAFAZE for additional IRSM information.

### 5.7 A32-SSAIM -- SOLID STATE ANALOG INPUT MODULE

The A32-SSAIM provides for 32 differential analog inputs. Analog input connections are made on two terminal blocks and the module can be plugged into any housing slot.

Only the -10 to +60mvdc range may be used with this module. If it is desired to connect current signals to the input of this module then it will be necessary to use the single loading resistor mounted on the plug in terminal block. See section 5.6.4 for resistor values.

## 5.8 SCALING AND CALIBRATION

Since a computer is used to display the reading and load the setpoints, a mathematical step can be used to convert measurements and setpoints to engineering units and correct for known sensor calibration errors.

For example, the ANAFAZE SYSTEM 32 does all thermocouple calculations in degrees F since this provides almost twice the resolution of degrees C. If degrees C display and setpoints are desired the computer makes the F to C conversion as data is received from the ANAFAZE SYSTEM 32 and converts the setpoints from C to F as they are sent to the controller.

In a similar manner, linear sensors can be converted to engineering units and adjusted for known calibration errors with a conversion step. For a linear sensor two outputs can be measured ( $x_1$  and  $x_2$ ) and converted into engineering units ( $y_1$  and  $y_2$ ) using the standard formula:

$$y = mx + b$$

where  $m = (y_2 - y_1)/(x_2 - x_1)$   
and  $b = y_2 - mx_2$  or  $b = y_1 - mx_1$

The same conversion formula can be used to convert the desired setpoint into a percentage of full scale which allows the ANAFAZE SYSTEM 32 to control to the actual measured signals while the computer displays the measurements and setpoints in engineering units. This approach eliminates the need for potentiometers and other analog adjustments on each input channel.


The ANASOFT-32 software for the IBM PC and compatible computers includes these scaling functions as part of the menu driven program. Please consult ANAFAZE for additional information.




## 5.9 DIAGRAMS OF TYPICAL INPUTS

SEE SECTION 5.6 FOR DETAILED INFORMATION.


### Typical Thermocouple

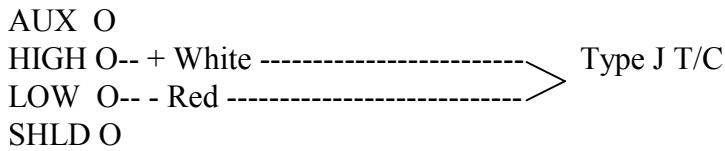


**Shielded Thermocouple:** To use shield remove jumper RD. Shield should be grounded at probe [see 5.6.2].

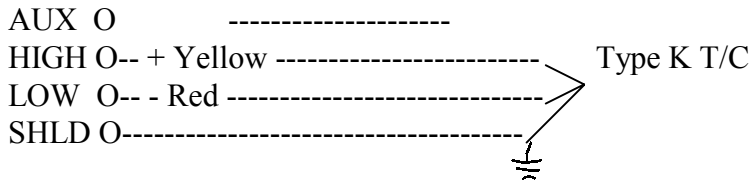


**DC Voltage Input:** Use scaling resistors to reduce the full scale voltage to 0 to 60mv. SEE SECTION 5.6.3 FOR SCALING RESISTORS VALUES OF RA AND RB.

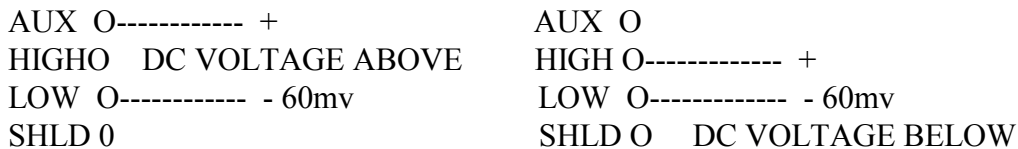

**Current Transmitter Inputs:** Use scaling resistors to convert the current to a voltage input scaled to 0 to 60mv. This will result in a 0 to 20ma full scale range, and an Mx + B scaling can be in the computer to display the engineering units. SEE SECTION 5.6.5 FOR SCALING VALUES OF RA, RB, AND RC. SCALING RESISTORS MUST BE INSTALLED.

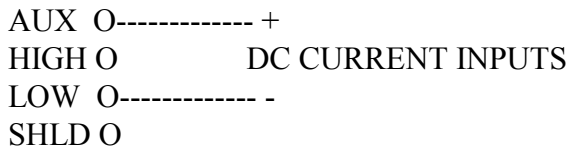

**RTD INPUTS:** The input loop must be configured for the three wire RTD input and must have the proper scaling resistors installed.

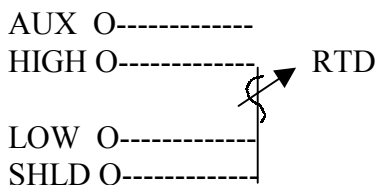

## 5.10 ANALOG INPUT CONNECTIONS

### 5.10.1 A32-RRAIM Analog Input Connections

Terminal 1 [Upper]			Terminal 2 [Lower]		
Pin	Channel	Assignment	Pin	Channel	Assignment
1		REF GND	1		+ REF
2		REF GND	2		+ REF
-----					
3		LO	3		LO
4	1	AUX	4	9	AUX
5		HI	5		HI
6		SHLD	6		SHLD
-----					
7		LO	7		LO
8	2	AUX	8	10	AUX
9		HI	9		HI
10		SHLD	10		SHLD
-----					
11		LO	11		LO
12	3	AUX	12	11	AUX
13		HI	13		HI
14		SHLD	14		SHLD
-----					
15		LO	15		LO
16	4	AUX	16	12	AUX
17		HI	17		HI
18		SHLD	18		SHLD
-----					
19		LO	19		LO
20	5	AUX	20	13	AUX
21		HI	21		HI
22		SHLD	22		SHLD
-----					
23		LO	23		LO
24	6	AUX	24	14	AUX
25		HI	25		HI
26		SHLD	26		SHLD
-----					
27		LO	27		LO
28	7	AUX	28	15	AUX
29		HI	29		HI
30		SHLD	30		SHLD
-----					
31		LO	31		LO
32	8	AUX	32	16	AUX
33		HI	33		HI
34		SHLD	34		SHLD
-----					
35		+REF	35		REF GND
36		+REF	36		REF GND

## 5.10.2 A32-SSAIM Analog Input Connections

### UPPER TERMINAL BLOCK

Pin	Channel	Assignment	Pin	Channel	Assignment
1	1	HI	2	17	HI
3		LO	4		LO
5	2	HI	6	18	HI
7		LO	8		LO
9	3	HI	10	19	HI
11		LO	12		LO
13	4	HI	14	20	HI
15		LO	16		LO
17	5	HI	18	21	HI
19		LO	20		LO
21	6	HI	22	22	HI
23		LO	24		LO
25	7	HI	26	23	HI
27		LO	28		LO
29	8	HI	30	24	HI
31		LO	32		LO
33			34		
35			36		

### LOWER TERMINAL BLOCK

Pin	Channel	Assignment	Pin	Channel	Assignment
1	9	HI	2	25	HI
3		LO	4		LO
5	10	HI	6	26	HI
7		LO	8		LO
9	11	HI	10	27	HI
11		LO	12		LO
13	12	HI	14	28	HI
15		LO	16		LO
17	13	HI	18	29	HI
19		LO	20		LO
21	14	HI	22	30	HI
23		LO	24		LO
25	15	HI	26	31	HI
27		LO	28		LO
29	16	HI	30	32	HI
31		LO	32		LO
33		REF	34		REF
35		RETN	36		RETN

## 6.0 CONTROL OUTPUTS

Control outputs are provided from the A32-PIOM -- PROCESSOR I/O MODULE for digital outputs and the A32-AOM -- ANALOG OUTPUT MODULE for analog outputs. The A32-AOM is not required for systems that do not need analog outputs. The A32-PIOM provides the digital control outputs, the serial communication, and miscellaneous digital inputs and outputs.

### WARNING -- GROUND LOOP POTENTIAL

**The ground of every control output is connected to the ANAFAZE 32 PID logic ground. Use caution when connecting external devices that may have their low side at a voltage other than controller ground, since potential ground loops can be created. Use isolated relays or the isolated control device inputs if possible grounding problems are expected.**

## 6.1 PROCESSOR I/O MODULE


Most PROCESSOR I/O MODULE [PIOM] connections are provided on plug in terminal blocks. Additional inputs and outputs are provided on ribbon cable connectors. The control outputs are also available on ribbon cable connectors to simplify external wiring. The pins used on the ribbon cable connectors can be used to connect these inputs and outputs to external terminal strips or standard I/O module boards such as the Gordos PCB24.

TB1 IS THE UPPER TERMINAL BLOCK and TB2 IS THE LOWER TERMINAL BLOCK. J1, J2, and J3 ARE CONNECTORS FOR RIBBON CABLES. These connectors can be used to reduce point to point wiring and must be used for the additional input and output connections.

Output 65 is used by the controller to indicate a high deviation alarm and output 66 to indicate a low deviation alarm. Output 67 is used by ANASOFT 32 to indicate a computer determined high process alarm and output 68 for the corresponding low alarm.


Typical control outputs utilize external optically-isolated solid-state relays. These relays use a 3 to 32vdc input for control and can be sized to switch up to 50 amps at 480vac. For larger currents these relays can be used to drive contactors. Connections are made as follows:

### Upper Terminal Block TB1

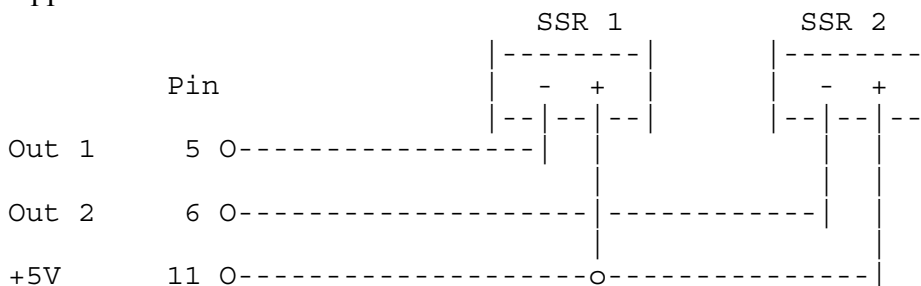

Alarm outputs are also used to activate SSR's when possible. The connections are essentially the same.

### Lower Terminal Block TB2

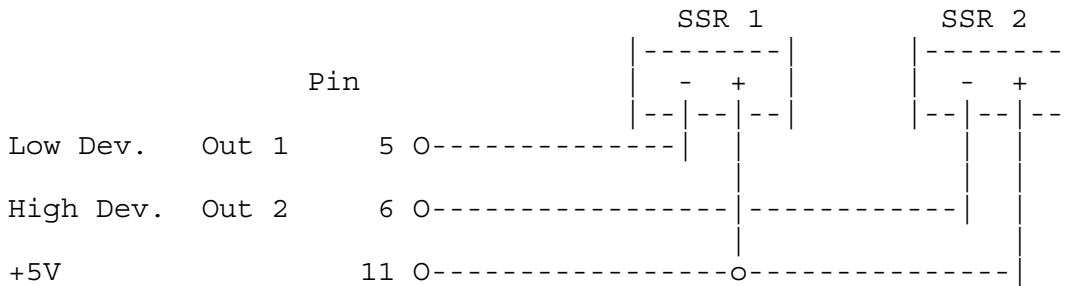


#### 6.1.1 PROCESSOR READY

The processor READY is a Watchdog Timer Output from the PIOM and is an indication that the microprocessor is running its program. This output is available at READY Pin #33 of the TB2 on the PROCESSOR I/O MODULE (PIOM).

This output is on [will sink current] whenever the microprocessor is functioning properly. The READY output takes about 2 seconds upon power up to indicate ready. The output is an open collector NPN transistor to ground, capable of sinking 15ma. Maximum ratings of 24vdc at 25ma should not be exceeded.


To use the READY output as a TTL signal, connect a 4.7Kohm resistor from the +5v supply Pin #31 to READY Pin #33 of TB2. Pin #33 will be TTL low(0v) with respect to ground Pin #32, when the processor is ready or running. Pin #33 will be TTL high(5v), when the processor is not functioning.

#### TTL output for Processor Ready

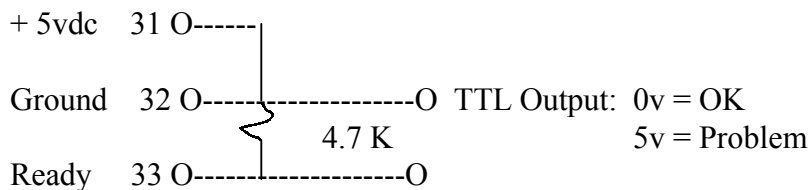

To use the READY output to energize a relay, an optically- isolated solid-state relay [SSR] is recommended. The control signal is +5v. Connect the positive terminal of the SSR to Pin #31 and the negative terminal to Pin #33. When the microprocessor is ready, the relay will be energized. Upon failure of the microprocessor, the relay would be de-energized. A Gordos #OAC5A or #G280D10 equivalent is recommended.

#### Processor Ready output connected to SSR

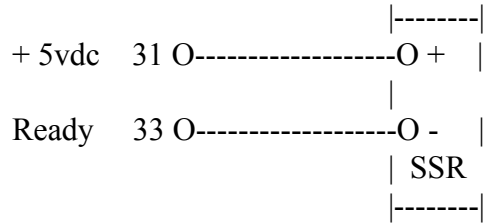


**6.1.2 OUTPUTS ENABLE: A32-PIOM ONLY**

The control outputs from the PIOM [TPV, ON-OFF, and DZC] for all 32 Loops are off, when Outputs ON Pin #35 of TB2 is TTL high or open. Also, the outputs are off, whenever the microprocessor is not ready.


**WARNING: If the outputs are not enabled through Pin 35, there will be no control output from the PIOM. The Outputs enable has no effect on the analog control outputs [A32- AOM].**

To enable the outputs, Outputs ON Pin #35 must be tied to ground Pin #32 by a jumper. If so desired, a relay contact may be used that would enable the outputs from some external circuit, such as a safety device. The outputs may also be enabled or disabled by a TTL signal. A TTL low will turn the outputs on and a TTL high will turn the outputs off. The TTL input should be connected between ground pin 32, and the Outputs ON pin 35.

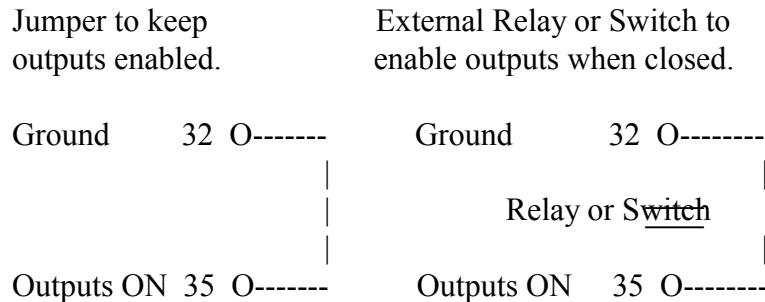

**6.1.3 COMMUNICATIONS WATCHDOG TIMER**

The communications watchdog timer output is on Pin #30 of TB2 the lower block on the PIOM. The output will be ON upon communication failure.

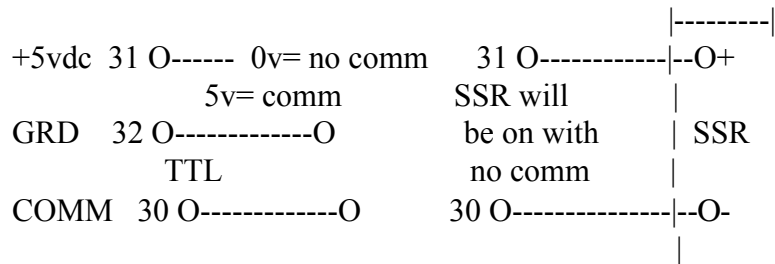

## 6.2 PROCESSOR I/O [A32-PIOM] PID OUTPUT CONNECTIONS

### 6.2.1 SCREW TERMINAL CONNECTIONS

Pin #	TB1 [UPPER BLOCK]	TB2 [LOWER BLOCK]
1	Tx+ COMPUTER COMMUNICATION	PID OUT LOOP 25
2	Tx- SEE SECTION 4	PID OUT LOOP 26
3	Rx+ COMPUTER COMMUNICATION	PID OUT LOOP 27
4	Rx- SEE SECTION 4	PID OUT LOOP 28
5	PID OUT LOOP 1 SEE SECTION	PID OUT LOOP 29
6	PID OUT LOOP 2 6.1 FOR	PID OUT LOOP 30
7	PID OUT LOOP 3 WIRING	+5V LOGIC SUPPLY
8	PID OUT LOOP 4	PID OUT LOOP 31
9	PID OUT LOOP 5	PID OUT LOOP 32
10	PID OUT LOOP 6	DIGITAL OUT 57
11	+5V LOGIC SUPPLY	+5V LOGIC SUPPLY
12	PID OUT LOOP 7	DIGITAL OUT 58
13	PID OUT LOOP 8	DIGITAL OUT 59
14	PID OUT LOOP 9	DIGITAL OUT 60
15	+5V LOGIC SUPPLY	+5V LOGIC SUPPLY
16	PID OUT LOOP 10	DIGITAL OUT 61
17	PID OUT LOOP 11	DIGITAL OUT 62
18	PID OUT LOOP 12	DIGITAL OUT 63
19	+5V LOGIC SUPPLY	+5V LOGIC SUPPLY
20	PID OUT LOOP 13	DIGITAL OUT 64
21	PID OUT LOOP 14	ALARM OUT65 HIGH DEVIATION
22	PID OUT LOOP 15	ALARM OUT 66 LOW DEVIATION
23	+5V LOGIC SUPPLY	+5V LOGIC SUPPLY
24	PID OUT LOOP 16	ALARM OUT 67 HIGH PROCESS
25	PID OUT LOOP 17	ALARM OUT 68 LOW PROCESS
26	PID OUT LOOP 18	DIGITAL OUT 69
27	+5V LOGIC SUPPLY	+5V LOGIC SUPPLY
28	PID OUT LOOP 19	DIGITAL OUT 70
29	PID OUT LOOP 20	DIGITAL OUT 71
30	PID OUT LOOP 21	COMM WATCH 72 COMMUNICATION TIMER
31	+5V LOGIC SUPPLY	+5V LOGIC SUPPLY
32	PID OUT LOOP 22	LOGIC GROUND
33	PID OUT LOOP 23	CPU READY WATCHDOG TIMER
34	PID OUT LOOP 24	I sense - OPEN HEATER SENSOR
35	+5V LOGIC SUPPLY	Outputs ON PID OUTPUTS ENABLE
36	LOGIC GROUND	I sense + OPEN HEATER SENSOR

#### NOTES!

1. TB2 PIN 35 OUTPUTS ON MUST BE CONNECTED TO LOGIC GROUND PIN 32 OF TB2 BEFORE PID DIGITAL OUTPUTS WILL BE ACTIVE.
2. THE PID OUTPUTS ARE NEGATIVE LOGIC WITH REFERENCE TO THE +5V LOGIC.
3. THE I SENSE OF PINS 34 & 36 ARE INPUTS FOR A SENSOR SIGNAL IN THE OPEN HEATER DETECTION CIRCUIT.

Spare digital outputs and digital inputs are not used in the standard SYSTEM 32.

## 6.2.2 A32-PIOM OUTPUTS 50 PIN FLAT RIBBON CABLE

### CONNECTIONS

IN #	J1 [TOP]	J2 [MIDDLE]	J3 [BOTTOM]
1	PID OUT LOOP 1	DIGITAL OUT 33	PID OUT LOOP 25
2	LOGIC GND	LOGIC GND	LOGIC GND
3	PID OUT LOOP 2	DIGITAL OUT 34	PID OUT LOOP 26
4	LOGIC GND	LOGIC GND	LOGIC GND
5	PID OUT LOOP 3	DIGITAL OUT 35	PID OUT LOOP 27
6	LOGIC GND	LOGIC GND	LOGIC GND
7	PID OUT LOOP 4	DIGITAL OUT 36	PID OUT LOOP 28
8	LOGIC GND	LOGIC GND	LOGIC GND
9	PID OUT LOOP 5	DIGITAL OUT 37	PID OUT LOOP 29
10	LOGIC GND	LOGIC GND	LOGIC GND
11	PID OUT LOOP 6	DIGITAL OUT 38	PID OUT LOOP 30
12	LOGIC GND	LOGIC GND	LOGIC GND
13	PID OUT LOOP 7	DIGITAL OUT 39	PID OUT LOOP 31
14	LOGIC GND	LOGIC GND	LOGIC GND
15	PID OUT LOOP 8	DIGITAL OUT 40	PID OUT LOOP 32
16	LOGIC GND	LOGIC GND	LOGIC GND
17	PID OUT LOOP 9	DIGITAL IN 9	DIGITAL OUT 57
18	LOGIC GND	LOGIC GND	LOGIC GND
19	PID OUT LOOP 10	DIGITAL IN 10	DIGITAL OUT 58
20	LOGIC GND	LOGIC GND	LOGIC GND
21	PID OUT LOOP 11	DIGITAL IN 11	DIGITAL OUT 59
22	LOGIC GND	LOGIC GND	LOGIC GND
23	PID OUT LOOP 12	DIGITAL IN 12	DIGITAL OUT 60
24	LOGIC GND	LOGIC GND	LOGIC GND
25	PID OUT LOOP 13	DIGITAL IN 13	DIGITAL OUT 61
26	LOGIC GND	LOGIC GND	LOGIC GND
27	PID OUT LOOP 14	DIGITAL IN 14	DIGITAL OUT 62
28	LOGIC GND	LOGIC GND	LOGIC GND
29	PID OUT LOOP 15	DIGITAL IN 15	DIGITAL OUT 63
30	LOGIC GND	LOGIC GND	LOGIC GND
31	PID OUT LOOP 16	DIGITAL IN 16	DIGITAL OUT 64
32	LOGIC GND	LOGIC GND	LOGIC GND
33	PID OUT LOOP 17	DIGITAL IN 1	ALARM HI DEV 65
34	LOGIC GND	LOGIC GND	LOGIC GND
35	PID OUT LOOP 18	DIGITAL IN 2	ALARM LO DEV 66
36	LOGIC GND	LOGIC GND	LOGIC GND
37	PID OUT LOOP 19	DIGITAL IN 3	ALARM HI PROC 67
38	LOGIC GND	LOGIC GND	LOGIC GND
39	PID OUT LOOP 20	DIGITAL IN 4	ALARM LO PROC 68
40	LOGIC GND	LOGIC GND	LOGIC GND
41	PID OUT LOOP 21	DIGITAL IN 5	DIGITAL OUT 69
42	LOGIC GND	LOGIC GND	LOGIC GND
43	PID OUT LOOP 22	DIGITAL IN 6	DIGITAL OUT 70
44	LOGIC GND	LOGIC GND	LOGIC GND
45	PID OUT LOOP 23	DIGITAL IN 7	DIGITAL OUT 71
46	LOGIC GND	LOGIC GND	LOGIC GND
47	PID OUT LOOP 24	DIGITAL IN 8	COMM WATCH 72
48	LOGIC GND	LOGIC GND	LOGIC GND
49	+5V LOGIC SUPPLY	+5V LOGIC SUPPLY	+5V LOGIC SUPPLY
50	LOGIC GND	LOGIC GND	LOGIC GND



### 6.3 ANALOG OUTPUT MODULE A32-AOM

Analog control outputs are provided for the SYSTEM 32 by using the A32-AOM. Each module provides 16 analog outputs and up to two modules can be used in a single SYSTEM 32 for 32 control outputs.

The AOM provides both 4 to 20ma with 400 ohms maximum load and 0- 5vdc at 5ma maximum. Both are available at the output terminals and either may be selected.

**WARNING: Both outputs may not used at the same time on the same loop. THE OUTPUTS WILL BE IN ERROR.**



**WARNING: The grounds of all the analog outputs on a single module are connected together. Ground loop problems and potential damage can result if the outputs are connected to devices that have common mode or other voltages on their terminals. Contact ANAFAZE for isolated outputs.**

#### 6.3.1 Typical Connections

The output connections are designated as C for the positive terminal of the current loops along with the loop number and the negative side of the current loop is to any of the terminals labeled NEG.

The positive output connections for the voltage loops are V along with the loop number and the negative side is to any of the terminals labeled NEG.

Typical Analog Output Connections are:

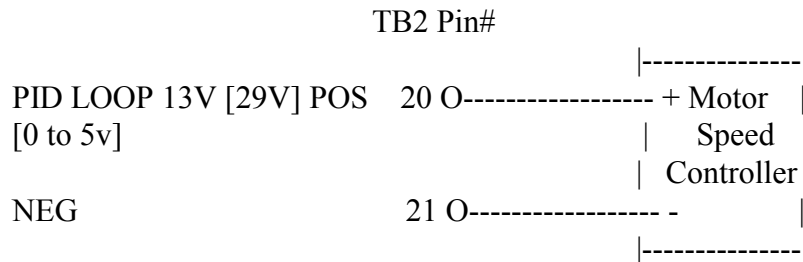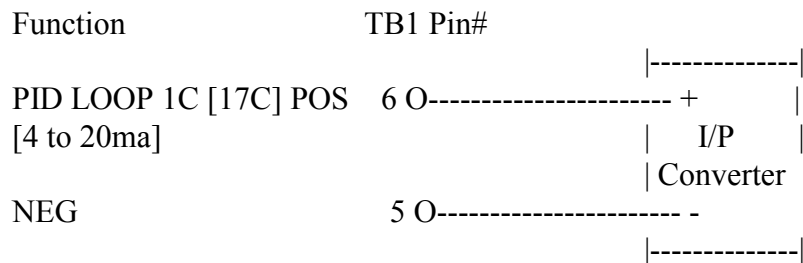

### 6.3.2 A32-AOM ANALOG OUTPUT MODULE CONNECTIONS

Note the outputs are designated as follows:

LOOP #C Positive terminal for 4-20ma dc output.

LOOP #V Positive terminal for 0-5vdc output.

NEG Negative terminals for both outputs.

TERMINAL BLOCK 1 [UPPER]		TERMINAL BLOCK 2 [LOWER]	
PIN	CONNECTION	PIN	CONNECTION
1	NEG	1	NEG
2	NC	2	PID LOOP 9C POS [25C]
3	NEG	3	NEG
4	NC	4	PID LOOP 9V POS [25V]
5	NEG	5	NEG
6	PID LOOP 1C POS [17C]	6	PID LOOP 10C POS [26C]
7	NEG	7	NEG
8	PID LOOP 1V POS [17V]	8	PID LOOP 10V POS [26V]
9	NEG	9	NEG
10	PID LOOP 2C POS [18C]	10	PID LOOP 11C POS [27C]
11	NEG	11	NEG
12	PID LOOP 2V POS [18V]	12	PID LOOP 11V POS [27V]
13	NEG	13	NEG
14	PID LOOP 3C POS [19C]	14	PID LOOP 12C POS [28C]
15	NEG	15	NEG
16	PID LOOP 3V POS [19V]	16	PID LOOP 12V POS [28V]
17	NEG	17	NEG
18	PID LOOP 4C POS [20C]	18	PID LOOP 13C POS [29C]
19	NEG	19	NEG
20	PID LOOP 4V POS [20V]	20	PID LOOP 13V POS [29V]
21	NEG	21	NEG
22	PID LOOP 5C POS [21C]	22	PID LOOP 14C POS [30C]
23	NEG	23	NEG
24	PID LOOP 5V POS [21V]	24	PID LOOP 14V POS [30V]
25	NEG	25	NEG
26	PID LOOP 6C POS [22C]	26	PID LOOP 15C POS [31C]
27	NEG	27	NEG
28	PID LOOP 6V POS [22V]	28	PID LOOP 15V POS [31V]
29	NEG	29	NEG
30	PID LOOP 7C POS [23C]	30	PID LOOP 16C POS [32C]
31	NEG	31	NEG
32	PID LOOP 7V POS [23V]	32	PID LOOP 16V POS [32V]
33	NEG	33	NEG
34	PID LOOP 8C POS [24C]	34	NC
35	NEG	35	NEG
36	PID LOOP 8V POS [24V]	36	NC

NOTE! OUTPUT LOOP NUMBERS ARE IN REFERENCE TO THE INPUT LOOP NUMBERS AND ARE SELECTABLE BY ADDRESS JUMPER.

LOOPS 1-16 ARE MODULE #1 OR ADDRESS #1.  
 LOOPS [17-32] ARE MODULE #2 OR ADDRESS #2

## 7.0 DETAILED MODULE DESCRIPTIONS

### 7.1 PROCESSOR I/O MODULE -- A32-PIOM

The PIOM is the main processor for the SYSTEM 32 and is required in each system. The only PIOM option available for standard systems is the type of communications interface.

The PIOM has two microprocessors, an 8031 and 8088. These microprocessors perform all the SYSTEM 32 software operations using programs stored in PROM's. The 8031 primarily manages the I/O functions including communications, while the 8088 performs the control calculations including PID and linearization thermocouple and other inputs. Other software functions include self-test of the system, on-line analog calibration, and open heater detection.

The PIOM is comprised of a two board set, the larger board is the 8031 processor and the smaller piggy back board is the 8088.

The SYSTEM 32 microprocessor programs allow control parameters and other operating conditions, such as input types, to be entered from an external computer through the built in serial interface. Communications protocol is a form of ANSI X3.28-1976, which is compatible with Allen-Bradley PLC's.

Up to 29 parameters, such as input type, control setpoint, deviation alarms, PID constants, can be entered for each loop. These parameters can be stored by command in EEROM, and the SYSTEM 32 will start according to these parameters on application of power or after a microprocessor reset.

**WARNING: Only a safe set of parameters should be stored in EEROM, since the system will automatically start with these values.**

#### 7.1.1 Control Outputs and Digital Inputs and Outputs

The standard SYSTEM 32 PIOM has 32 digital control outputs, 8 alarm and status outputs, an additional 16 digital outputs, and 16 digital inputs.

In the simplest SYSTEM 32 configuration, the PIOM may be used without any other modules as an open loop controller with 32 manually set control outputs. The outputs can be set to any level [percent of full scale] from the system computer.

When used for closed loop control, the 32 control outputs correspond to the first 32 analog inputs. Additional analog inputs up to 96 total per PIOM, are used for data acquisition. A special version of the SYSTEM 32 is available for 48 control loops.

The control outputs may be independently software set as on/off, or pulsed dc outputs with a choice of Cycle Time Proportioning or Distributed Zero Crossing. The control action can be independently set for Reverse [Heat] or

Direct [Cool]. The outputs are 5vdc at 16ma maximum and are normally used to switch optically-isolated solid-state relays (SSR's).

The alarm and status outputs include a global high and low deviation and a watchdog timer which are set by the SYSTEM 32. If ANASOFT-32 is used in the system computer, a global high and low process alarm output is set from the system computer. These outputs are also 5vdc and are designed to connect to SSR's.

The additional digital I/O are used by special versions of ANASOFT-32. Eight digital outputs are available on the terminal strips, and the remaining 8 digital inputs and 16 digital outputs are provided on a 50 pin ribbon cable connector. The pin configuration is compatible with standard I/O modules such as Gordos PB24.

### **7.1.2 Communication**

The type of communication interface is determined by the distance the 32 System will be from the host computer. The communications interface type is set at the factory. RS-232 is recommended up to 50 feet although it can be used up to 500 feet with special cables in low electrical noise environments. For longer distances either the 20ma Current Loop (up to 5000 ft.), or the RS-485 (up to 10,000 ft.) is recommended. The 20ma current loop is a dual twisted pair serial connection and RS-485 is 4 or 2 wire balanced line parallel connection.

### **7.1.3 Address and Option Switch**

An 8-position dip switch on the PIOM provides for the address selection. The addresses allow up to 16 SYSTEM 32 PIOM's to be on the same communication line. It also allows selection of the baud rate of 2400 or 9600 as well as other communication parameters.

### **7.1.4 Terminal Blocks**

Push on, screw locked terminal blocks are provided on each module for connection of field wiring. The blocks are large enough for most types of input wiring. The blocks can be removed to service the modules without the need to remove the field wiring. The blocks also include temperature stabilization to improve the reference junction compensation when thermocouples are directly connected.

## **7.2 REED RELAY ANALOG INPUT MODULE -- A32-RRAIM**

The RRAIM provides the connections for up to 16 analog inputs to the SYSTEM 32. Analog inputs are sequentially switched to a frequency [V/F] converter powered by an isolated supply. The pulse output from this V/F passes through an optical-isolator and to the PIOM where the pulses are counted and the readings are determined. In addition to the analog inputs, two temperature sensors at each end of the terminal blocks are measured for use as an electronic reference junction for directly connected thermocouples.

### **7.2.1 Automatic Calibration**

The RRAIM includes two additional inputs: a full scale and a zero signal that are used by the PIOM for automatic full scale and zero calibration. The zero input is read on one scan to calibrate the analog amplifier zero, on the next scan the full scale input is read to calibrate the amplifier gain. The next two scans are used to read the thermocouple reference temperatures and then the calibration cycle starts again. Thus calibration is automatically updated every two seconds.

### **7.2.2 Noise Rejection**

The 16 channel reed relay input provides the highest level of protection from input noise present in most industrial applications. By using a 3-pole relay and switching both inputs for true differential measurement, and the shield for noise rejection, up to 180vac of common mode voltage may be present on an input without effecting calibration.

For further noise protection, the integration period for the voltage to frequency converter is set at one period of the 60Hz power line frequency. This provides high rejection of power line induced noise.

### **7.2.3 Resolution**

The combination of the integration time period and the full scale frequency output of the V/F results in a measurement resolution of one part in 5000, or 0.02%. This is slightly higher than 12 bit [one part in 4096] resolution.

The resolution of 0.02% full scale results in a measurement resolution of better than 14 microvolts. This means that the typical thermocouple resolution for a type J or T is 0.5 °F, for a type K 0.75 °F, and for type R or S 2.0 °F.

### **7.2.4 Scanning Speed**

The SYSTEM 32 with the RRIAM, measures each input twice per second. The PIOM performs the complete PID calculations for all loops in less than this time, thus every loop is updated twice per second. The PIOM scans each RRAIM in parallel so the addition of RRAIM's to the system will not add to the scanning or loop update time.

### **7.2.5 Analog Input Range**

The analog input range of the RRAIM is -10 to +60mv. To measure other inputs, such as 4-20 ma, scaling resistors are used. The RRAIM contains an isolated section for the purpose of mounting scaling resistors. These resistors may be mounted by the factory [order A32-SI as needed] by the user.

### **7.2.6 RTD Excitation Voltage**

The excitation voltage for RTD's is 10vdc at 50ma max. When using RTD's, a max current of 3ma per sensor is recommended to avoid self-heating of the RTD as well as avoiding overloading the RRIAM power supply.

### **7.2.7 Open Thermocouple Detection**

The RRIAM has upscale open thermocouple detection which is accomplished by placing a small current through the thermocouple leads. The input source impedance may go as high as 200 ohms before rated accuracy is effected.

### **7.2.8 Address Selection**

Each RRIAM has a jumper for address selection of the RRIAM in the SYSTEM 32. As many as three RRAIM's may be used per system.

## **7.3 SOLID STATE ANALOG INPUT MODULE -- A32-SSAIM**

The SSAIM is similar to the RRAIM except that the input channels are switched with 2 wire solid state multiplexers instead of 3 pole reed relays. The result is less voltage standoff [10volts maximum] between the inputs and the input grounds. The number of input channels is increased to 32 at about the same cost of 16 reed relay inputs.

The scan rate is still at 32 channels per second, thus each channel is updated every second. The PIOM still scans the SSAIM's in parallel, thus additional SSAIM's will not add to the scanning time.

The maximum number of SSAIM's per system is three. This gives a total of 96 inputs for a low cost data acquisition system.

Both RRAIM's and SSAIM's can be used in the same SYSTEM 32. The first 32 inputs are used for closed loop control.

## **7.4 ANALOG OUTPUT MODULE -- A32-AOM**

The AOM is used when an analog output signal is required to control the final control element. The 16 channel AOM provides a 4-20ma output [maximum load 400 ohms] or 0-5v output [5ma maximum]. Either output can be selected for each loop on the terminal block.

**Warning: Only one output may be used for each loop.**

Other outputs are available upon special order, contact ANAFAZE.

The 8-bit Digital/Analog (D/A) converter supplies the necessary signal to the output transistors according to the PIOM control calculations. The analog control output for a particular loop verses a digital control output on the PIOM is software selected.

The output transistors have a compliance voltage of 8vdc and all outputs share a common ground which is isolated from the system ground.

**Warning: The analog outputs must not be connected to devices that feedback power line AC or other voltages to the AOM. If there is voltage present optical isolators must be used. Please consult ANAFAZE for more information.**

Each AOM has an address Dip switch for address selection of the AOM in the 32 System. Up to two AOM's may be used in each SYSTEM 32.

#### **7.5 PULSE INPUT MODULE -- A32-PIM**

The PIM counts up to 32 pulse inputs at maximum pulse rates of 1kHz with 50% duty cycle pulses. The A32-PIM can only be used in systems with an expanded PROCESSOR I/O MODULE [A32-PIOM-EX].

#### **7.6 POWER SUPPLY----PART NO. A32-PS**

The power required by the SYSTEM 32 is 5 vdc at 5 amps. Each module of the SYSTEM 32 has a DC to DC converter for isolation and to provide the regulated voltages used. These voltages are typically +5vdc and  $\pm 15$ vdc.

Since each module includes isolation and regulation, nearly any 5vdc supply can be used. The SYSTEM 32 can be run from battery power since only a single voltage is required.

The A32-PS includes a standard SYSTEM 32 front panel, and wiring to the SYSTEM 32 backplane. The power supply is normally mounted in one module slot. For systems that require all the slots for other modules, the power supply can be mounted externally.

The rating of the A32-PS is 120 vac input with 5 vdc at 7 amp output. The power supply has an adjustment for the 5 vdc.

For a spare supply, option A32-PSWOF [Power Supply With Out Front Panel] is available.

#### **7.7 OPERATOR STATION -- A32-OS**

The OPERATOR STATION is used to view the measured input value or Process Variable (PV) for any loop of the SYSTEM 32. The OPERATOR STATION can also be used to change the Setpoint (SP) of a loop at a remote location from the computer.

The OPERATOR STATION is a panel mount 1/8 DIN LED readout instrument utilizing the communication line from the computer to the 32 System. The OPERATOR STATION front panel contains the function keys for the display selection and setpoint changing.

The OPERATOR STATION requires ANASOFT-32 to be running in the system computer. It obtains its readings and changes the setpoints through the computer.

The OPERATOR STATION can select any PIOM and any loop in the system for display and changes. The SP may be viewed for any loop in the system and may, if elected by the customer, be changed from the OPERATOR STATION. The ability to change SP from the OPERATOR STATION is selected in ANASOFT-32 by the user.



## **8.0 PID CONTROL**

This section provides some common definitions of control terms and information on control loop tuning.

### **8.1 CONTROL LOOPS**

A control loop may consist of four or five elements depending upon the placement of the functions of some elements. These elements are defined as follows:

**PRIMARY ELEMENT:** This senses the **PROCESS VARIABLE (PV)**, a thermocouple (T/C) measuring temperature is an example.

**SIGNAL CONDITIONER ELEMENT:** this may be required between the **PRIMARY ELEMENT** and the **CONTROLLER ELEMENT** if the signal cannot be directly connected to the **CONTROLLER ELEMENT**. An example is a pH transmitter.

**CONTROLLER ELEMENT:** accepts the signal from the **PRIMARY ELEMENT** and sends the appropriate control signal to the **FINAL CONTROL ELEMENT**. An example is the **SYSTEM 32**.

**FINAL CONTROL ELEMENT:** accepts the control signal from the **CONTROLLER ELEMENT** and controls the **MANIPULATED VARIABLE ELEMENT**. An example is a motor positioning valve unit for the control of natural gas into a burner system or a Solid State Relay (SSR) controlling voltage into an electric load.

**MANIPULATED VARIABLE ELEMENT:** is the energy of the process such as steam, natural gas, etc... needed by the process for the Process Variable to reach Setpoint.

The **FINAL CONTROL ELEMENT** may be controlled in open loop, that is with out feedback or direct measurement of the Process Variable. For open loop control the control output from the **CONTROLLER ELEMENT** is set to some output level to produce a desired effect. This assumes that the process is slow enough for corrective action to be taken based on information from another source other than the **PRIMARY ELEMENT** or the process characteristics are such that open loop control will hold the Setpoint within desired limits.

Closed loop makes use of feedback from the process, comparing the Process Variable to the Setpoint, and changing the control output automatically as required to control the process.

**OPEN LOOP** is also known as **MANUAL CONTROL**, while **CLOSED LOOP** is known as **AUTOMATIC CONTROL**.

#### **8.1.2 CONTROL MODES**

The control mode is the form of control function. In the **SYSTEM 32** the choices are: on/off, proportional [P], proportional and integral [PI], and proportional with integral and differential [PID]. The control mode should

not be confused with with the type of control output signal: for example pulsed DC voltage or analog output.

### 8.1.3 ON/OFF CONTROL

The simplest way to control the PROCESS VARIABLE (PV), for example temperature on an oven, to a desired SETPOINT (SP), operating temperature, is to use ON/OFF control. When the temperature is below the setpoint the heat is turned fully on and when the temperature is above the setpoint the heat is turned fully off. The result of ON/OFF control is usually the cycling of the PV around the SP. The amount of PV deviation from the SP is primarily due to the process dynamics rather than the controller gain.

Most ON/OFF controllers GAIN, [also known as DEADBAND, HYSTERESIS, or SENSITIVITY] is a fixed percentage of the controller input span. Thus, a gain of 1/2% of a 0-1400 °F Type J span would be 7 °F. This means the controller will not switch the output on, until the PV falls below SP by 3.5 °F and will not switch the output off, until the PV rise above SP by 3.5 °F. Occasionally the deadband is too narrow for the process and intermittent chattering of the Final Control Element may be present. An adjustable gain on the ON/OFF controller function is very useful for eliminating Final Control Element chatter. The SYSTEM 32 provides adjustable gain for ON/OFF control loops.

The Final Control Element most often used with ON/OFF control is the relay. For example relays can be used for electrical heating loads, solenoid valves, and two-position motor control.

### 8.1.4 PID CONTROL

PID or 3-mode control is used when ON/OFF control is not satisfactory for the control requirements of the process. If cycling of the PV cannot be tolerated, if process loading is a variable, and if the SP is changeable, then PID would most likely be used in place of ON/OFF control.

The **PID** initials stand for **PROPORTIONAL, INTEGRAL, and DERIVATIVE**. The SYSTEM 32 utilizes the ISA standard PID equation to calculate the control output as follows:

$$U = \frac{1}{FSR} \int K_p \left( e + \frac{1}{T_I} \int e dt + K_D \frac{de}{dt} \right) dt$$

Where:

U is the control output in percent of output full scale. For a 4-20ma output, 0% is 4ma, 50% is 12ma, and 100% is 20ma.

e is the error [the difference between the PV and SP].

FSR is the full scale range of the measured input. For a J thermocouple the full scale range is -350 to 1400 °F, or 1750 °.

$K_p$  is the proportional gain, and  $FSR/K_p$  is referred to as the proportional band PB. The gain can be set from 0 to 255 for the SYSTEM 32. Note that when gain is specified in the control equation the output would be different for the same error if a different full scale is used. If PB is used the FSR cancels out and the PB is independent of the input range.

TI is the integral or reset time, and  $1/TI$  is referred to as the reset rate. For the SYSTEM 32, the integral or reset time can be set from 0 [off] to 1020 seconds with 4 second resolution. This corresponds to a reset rate of 0.05 to 15 repeats per minute.

TD is the derivative time and the range for the SYSTEM 32 is 0 [off] to 255 seconds or 0.01 to 4.25 minutes.

### **8.1.5 PROPORTIONAL CONTROL [P]**

Proportional control is when the control output signal is linearly proportional to the error. In the above equation the integral and derivative effects are zero. For the SYSTEM 32 this is accomplished by setting the integral and derivative constants to zero. The proportional constant is also known as gain.

As the gain of the controller is increased a small increase in error will cause a large change in the control output. Since cycling of the PV can result from high gain, reducing the gain is one way to improve stability.

In the control equation, once the error times the gain divided by the full scale range reaches 100% [full control output] additional error cannot increase the control output. If the error is less than this value a control response proportional to the error is made. Thus if the error is less than  $FSR/K_p$  it is said to be within the PROPORTIONAL BAND (PB). The PB is equal to the full scale of the controller input divided by the gain. Thus a gain of 100, for a thermocouple with a range of 0 to 1400 °F, results in a proportional band of 140 °F.

Using ANASOFT-32 for the SYSTEM 32 allows the a choice of displays for the proportional function. This function can be shown and entered as either Gain or Proportional Band. If proportional band is selected, the values can be entered IN THE ACTUAL ENGINEERING UNITS OF THE INPUT regardless of the span of the instrument. Thus, a PB of 30 represents 30 °F for any thermocouple input range in the SYSTEM 32.

Gain may also be used, but once again the input span of the controller becomes critical. For the SYSTEM 32, a gain of 30 represents 48 °F PB for a Type J T/C, 87 °F for a Type K T/C, and 29 °F for a Type T T/C. To obtain PB divide the span by the gain setting.

For temperature control, the most useful and easiest to use entry is the PB in actual degrees for the SYSTEM 32. The nominal setting of the PB can be between 5-20% of the SP. Thus, a SP of 300 °F may require a PB of 15-60 °F. To start use 10% of the SP.

A good way of establishing a PB setting is to start at a wide PB and then to keep decreasing the PB [increasing gain] until the process cycles about the SP. Take note of the PB at this point and double the figure. PB should be set at this number. Reset should be set to a low value such as .3 [or set integral to zero: off] and derivative should be at zero [off] before tuning PB.

The PB of 30 °F with a SP of 300 °F specifies that the output from the controller will change proportionally from 0 to 100% over 30 degrees. The output will be at 0% or 100%, if the PV is outside the PB of 30 °F from the SP of 300 °F. Below 270 °F [greater than a 30 ° error] the output will be at 100%, at 285 °F it will be at 50% and at 300 °F and above it will be at 0%.

All PID control functions take place within the PB, otherwise the controller output is full on or full off with no Integral or Derivative action.

#### **8.1.6 PROPORTIONAL AND INTEGRAL CONTROL [PI]**

The Integral mode is also known as RESET action. Reset is the older of the two terms and is descriptive of the control action that takes place. The primary reason for for integral control is to reduce or eliminate steady state errors, but this benefit typically comes at the cost of reduced stability.

With proportional only control the output will be zero when the PV is at SP [error is zero]. Thus, in a heating system for example, the stable temperature will always be below the setpoint. When the PV is stable at a point above or below the SP, the deviation from the SP is known as OFFSET. The control action that corrects for this offset, is integral or reset.

Reset is only active when the PV is not equal to the SP. The unit of Reset most often used is called Repeats/Minute (R/M). This expresses the number of times the PB response is repeated in one minute. This means with one repeat per minute, that the control output would be exactly double the proportional band [repeats the proportional band] only, if the error [SP-PV] remained steady for the full minute. As long as reset is active, it will repeat the PB response until the output has reached 0% or 100%.

MANUAL RESET is a manual biasing of the output, so that when the PV is at SP, the output will be at the proper level to hold SP. It is more common on older type controls. The newer controllers including the SYSTEM 32 provide AUTOMATIC RESET as described above. AUTOMATIC RESET automatically makes the correction for offset errors, but the R/M value must be set for the process.

Another way of viewing the reset action is to look at the integral term in the control equation of section 8.1.4. The control output due to this term is the error integrated over time. Thus a small offset over a long period of time will increase the integral sum and consequently the control output until the PV is equal to the SP. At this time, the proportional control output will be zero and the system will be stable at setpoint due to the integral sum.

Consider again the above example, with the PB at 30 and the SP at 300 °F, 50% of the output is obtained at 285 °F, but zero output is obtained at SP. Assuming 50% output is required to hold the temperature at 300 °F, it would be reasonable to assume that the PV would be stable at 285 °F. This results in an offset of 15 °F from 300 °F SP. To shift the PB so that 50% of the output is at 300 °F, reset is used.

If, AUTOMATIC RESET is used with .5 R/M and assuming the last PB response was 10% and the output is 50%. After the first minute, the output will be at 55%. After the second minute, it will be at 60%. After the third, 65% and so until the output is at 100%. It would take ten minutes to do this, assuming that there was no temperature rise. Since the temperature would actually increase, the error would be reduced and the portion of the control output due to proportional control would decrease. Since the value of the integral sum is increasing with time, the effect of the reset output increases. This interaction would continue until SP was reached, where reset holds the temperature at setpoint and the proportional output becomes zero.

A .5 to 1 R/M would be a good starting point for most processes. A slow process requires a slow reset (less than 1R/M). When too fast of a reset is used, the PV may slowly cycle around the SP. When adding RESET to the control mode of a controller, the addition of the RESET mode normally requires widening of the PB from the PROPORTIONAL mode control only setting.

### **8.1.7 PROPORTIONAL, INTEGRAL, AND DERIVATIVE CONTROL [PID]**

The Derivative mode is also known as RATE, ANTICIPATION, or APPROACH. RATE is the more common term used. The function of RATE is to prevent the overshoot or undershoot of PV at SP. It does this by slowing the rate of approach of the PV to the SP.

When using PB with RESET, the PV will sometimes go past the SP when a setpoint change or process disturbance occurs. This can happen since the correct setting of the PB will cause a small damped oscillation around the setpoint and the integral sum built up by the reset function cannot be reduced until the PV is past the setpoint. Thus, a Two-Mode controller may have overshoot, even if it is correctly set.

Most processes can tolerate an overshoot, but if the overshoot of the PV relative to the SP cannot be tolerated, then the RATE function must be used.

RATE is also used to correct for rapid load changes, to slow large capacity processes, and to overcome the slow rates of electric motor actuators.

The RATE function responds to the change in the error as a function of time. Mathematically it is the first derivative of the error as a function of time [see equation in section 8.1.4]. Thus if the error is steady the effect of rate is zero. As the PV approaches the setpoint, the rate term will be negative and reduce the control output. This will serve to slow the approach to setpoint and reduce the tendency to overshoot. The higher the rate, the faster the output is reduced, thus preventing overshoot. Too high a setting of the rate will cause the PV to undershoot the setpoint and the approach will be series of undershooting steps.

With PID control the output signal is a composite of the three control functions and will vary as the constants for these functions are changed as required to hold the PV to the SP. In general:

Increasing:  $K_P$  and  $1/T_I$  reduce system errors.

Decreasing:  $T_I$  reduces stability, but speeds the settling time.  
Setting  $T_I = 0$ , turns off reset.

Increasing:  $T_D$  improves stability. Setting  $T_D = 0$ , turns off rate.

### **8.1.8 ANAFAZE OUTPUT FILTER**

The OUTPUT FILTER used by the ANAFAZE Controllers is a digital filter on the output signal after the PID functions. It has a range of 0-255 levels that gives a time constant of 0-127.5 seconds. It is used to filter out erratic swings of the output due to extremely sensitive input signals, such as open air T/C in a dry air gas oven or a turbine flow signal.

It can be used also to allow the SYSTEM 32 to function more effectively than with PID alone. Some processes may be very sensitive, requiring a wide PB, such that good control control is not possible. By increasing the digital output filter to reduce the high and low output swings due to the process, the PB may be narrowed (lower number -- higher gain) to obtain good control.

The filter can also be used to forgive badly tuned PID loops and poorly designed processes. It may also be used to reduce output noise [control output cycling] when a large amount of derivative action is required.

### **8.1.13 REVERSE-DIRECT ACTION**

The ACTION of the control OUTPUT with RESPECT to the PV is known as REVERSE ACTION, if the OUTPUT INCREASES as the PV DECREASES. If the OUTPUT INCREASES as the PV INCREASES, then it is known as DIRECT ACTION.

Heating applications normally uses REVERSE ACTION and cooling applications normally will use DIRECT ACTION. The selection may also be dependent upon the application of two competing mediums of energy such as in a HEAT/COOL or TEMPERATURE/HUMIDITY applications.

#### **8.1.14 HEAT/COOL DUAL OUTPUTS**

Certain processes such as plastic molding, plastic extrusion, refrigeration systems, test chambers, and others require both heating and cooling control loops. In many cases a single process variable is used for dual output, that is, it controls both heating and cooling. To optimize the process it may be necessary to have different setpoints with a deadband between them, different PID or other control constants, and different output types for the heat/cool loops. For example, a mold may be heated using PID control through a phase angle fired power controller, while cooling is accomplished using on/off control through a cooling water valve.

Dual outputs are provided by directing a single analog input to two control loops. This approach is practical because of the low system cost. Two configurations are available:

For systems with only a few heat/cool loops, a single sensor is connected to two analog inputs. One loop is then used for heating and the second for cooling. This is practical in the SYSTEM 32 since the cost per loop is reasonably low and fully isolated inputs are available if needed.

For systems that are nearly all heat/cool, a single reed relay analog input module can be jumper set to direct each analog input to two independent loops.

In both cases each loop is fully independent and can have its own setpoint, control mode, and output signal type. The separate setpoint allows for a deadband adjustment not normally possible in many controllers. Three-Position or Two-Position floating control can be implemented by selecting the proper setpoints for the heating and cooling loops.

#### **8.1.9 CONTROL OUTPUTS**

The SYSTEM 32 provides two signal types for use as control outputs: digital and analog. The type of output is selected from software. If the system uses any analog outputs the optional A32-AOM ANALOG OUTPUT MODULE is required.

#### **8.1.10 DIGITAL OUTPUT**

Digital outputs normally control the process using relays. Two types of control are used: ON/OFF and TIME PROPORTIONING. Time proportioning is also referred to as pulsed DC output.

On/off control has been described in section 8.1.3.

Time proportioning control is a method of using a digital output and an on/off device such as a relay to essentially achieve an analog control signal. When the controller calculates the required control signal, it converts the percent output into a percent duty cycle and outputs this to the process through the relay. The process itself integrates this output and responds as if this percentage was applied in an analog manner.

For example, in a temperature process, if the controller requires 23% power output, it will set a duty cycle for the relay such that it is fully on for 23% of the time, and off for 77% of the time. If the time constants of the process and the type of relay have been correctly determined, this will result in the same temperature as if the heater could have been analog adjusted and the power had been set to 23%. The advantage of this type of control is that a relay is a relatively inexpensive way to control the heater power.

Different relay types may be used depending on the power and other process requirements: ELECTRO-MECHANICAL or SOLID STATE [SSR]. Modern SSR's can switch up to 480vac at 75 amps.

The digital outputs of the SYSTEM 32 are designed to drive optically-isolated SSR's. If electromechanical relays are required, an SSR should be used to connect the SYSTEM 32 to the relay. This approach will protect the controller from wiring errors and isolate every output from the others.

The ANAFAZE SYSTEM 32 offers two types of time proportioning outputs: Cycle Time Proportioning and Distributed Zero Crossing. Cycle time proportioning is normally used for electro-mechanical relays and Distributed Zero Crossing is typically used for solid state relays

CYCLE TIME PROPORTIONING is the proportioning of a selected fixed cycle time between an ON time versus an OFF time. With a cycle time of 10 seconds and a required control signal of 40% the on time would be 4 seconds and the OFF time would be 6 seconds. If the next control calculation required 38% output the on time would be 3.8 seconds and the off time 6.2 seconds. Thus as the PID control calculation changes the output required the system responds exactly, and the output duty cycle is adjusted to maintain the process at the setpoint.

Cycle Time Proportioning is primarily used on electrical energy type of processes. Some applications may use solenoid valves in a time proportioning mode, rather than ON/OFF. The general rule of thumb for cycle time is no less than 10 seconds [20 recommended] for electro-mechanical relays and no more than 5 seconds [2 recommended] for SSR's. Normally the faster the cycle time, the closer the control and the more wear on the relays.



### **8.1.11 DISTRIBUTED ZERO CROSSING**

Distributed Zero Crossing [DZC] output is the other time proportioning output available from the SYSTEM 32. This output is primarily for very fast acting electrical heating loads using SSR's. The open air heater coil is an example of a fast acting load. It should never be used with electro-mechanical relays.

The combination of Distributed Zero Crossing and a solid state relay can approach the effect of analog phase angle fired control at a reduced cost.

The DZC output is a TIME PROPORTIONING output where the controller decides for each cycle of the AC line if the power should be on or off. There is no fixed cycle time since the on/off decision is made for each AC cycle.

For example if the control output is 25% the power would be turned on for 1 AC cycle and off for the next 3 AC cycles. This pattern would repeat until the output level changed, for example to 28%. The power would then be on for 1 AC cycle and off for 3 cycles, then after repeating 1 on and 3 off several times the power would be set on for 2 cycles and off for 2 cycles. The result is after 100 cycles the power will have been on for 28 cycles and off for 72 cycles.

Since the time period for 60Hz power is 16.6ms the switching interval is very short and the power is applied very uniformly. Switching is still only done at the zero crossing of the AC power reducing the generated electrical noise.

### **8.1.12 ANALOG OUTPUTS**

Analog outputs may be CURRENT or VOLTAGE and are continuously proportional over the range of the output signal level. The SYSTEM 32 matches the standard industrial signal levels by providing 4 to 20 ma for the CURRENT output and 0 to 5 vdc for the VOLTAGE output.

The analog signals drive many types of FINAL CONTROL ELEMENTS such as electric proportioning motors for gas valve control of burner systems, I/P transducers for pneumatic control of valves, and SCR controls for phase angle control of electrical loads.

## **8.2 ADJUSTMENT OF PID CONSTANTS**

The SYSTEM 32 is normally operated using ANASOFT-32 in a system computer. For other installations the constants can be adjusted in a similar manner using the software supplied.

ANASOFT offers a choice of displays for the control constants. For many people, the use of Proportional Band is the most logical way to view these constants. If this display is desired it must be selected in the ANASOFT-32 installation program QINSTALL.

In addition the Plot History function should be set up to correctly display the PV of the loops being tuned. The time base must be adjusted prior to the start of tuning,

and the full scale adjusted to match the expected PV range. The graphics of the Plot will show the effect of the PID tuning in real time.

The understanding of PID functions would be useful in tuning loops, but not essential to a successful application of PID constants to a control loop.

### 8.2.1 INITIAL VALUES FOR PID LOOPS

The following values may initially be used for the PID constants. They have been used for many applications and will serve as a starting point for tuning the controller. If ANASOFT is used be sure the SYSTEM 32 control is set for AUTO.

#### ON/OFF CONTROL

PB = Minimum PB	Gain = 510
Reset = 7.5 R/M	Integral = 8 Sec.
Rate = 0 Min.	Derivative = 0 Sec.
Output Filter = 4	Output Filter = 4

#### PROPORTIONAL BAND ONLY (P)

PB = 5% of SP Example SP = 450 PB = 22	Gain = 79 [J T/C]
Reset = .12 R/M	Integral = 500 Sec.
Rate = 0	Derivative = 0 Sec.
Output Filter = 4	Output Filter = 4

#### PB with Reset (PI)

PB = 10% of SP Example SP = 450 PB = 45	Gain = 39 [J T/C]
Reset = .5 R/M	Integral = 120 Sec.
Rate = 0	Derivative = 0 Sec.
Output Filter = 4	Output Filter = 4

#### PB with Reset with Rate (PID)

PB = 15% of SP Example SP = 450 PB = 67	Gain = 44 [K T/C]
Reset = 1 R/M	Integral = 60 Sec.
Rate = 0.2/Min.	Derivative = 12 Sec.
Output Filter = 4	Output Filter = 4

**WARNING: never set the reset above 3 R/M or integral below 20 seconds for proportional control as cycling will occur.**

In controlling a process to a SP, process engineering must design the system to allow the controller to be within it's control capability. In most processes, the controller element is the fine control, while the process itself is the course control. If all of the variables could be defined and precisely controlled, when engineering a process, then a predetermined reset could be used. When sizing control valves, electrical loads or whatever the final element might be, the correct sizing will be one that allows the controller output to be in the 40-60% of it's output when PV is stable at SP at mid-

range of the process control span. If the process elements are not correctly sized then it will be difficult and even impossible to tune the controller.

### **8.2.2 TUNING PID LOOPS**

1. First set PB to 2% of the desired SP, Reset to .2 R/M, Rate to 0, Filter to 0. Set control in AUTO. Set the plot function for the proper range to record the PV over an appropriate time base such as one hour.

2. The SP is set to the desired control point. If overshoot cannot be tolerated, set the SP to a value below the final SP for tuning. Most heat processes are slow reacting compared to many other types of control systems. Usually 20 minutes are required between adjustments to see any effective change. After a suitable wait, look at the Plot Function. If cycling is not occurring, the PB is set correctly. If cycling is occurring, double the PB. After a suitable interval [normally at least 20 minutes] if cycling is still occurring, double the PB again. Repeat this process until the cycling stops. The time between cycling peaks will usually be about 5 to 15 minutes. A small amount of cycling may be removed by using the digital output filter allowing a narrow PB without cycling.

3. With the PB at the Setting from Step 2, increase the reset in steps of .3 R/M. Keep increasing the reset until, by watching the Plot Function, cycling is occurring at a slow rate. The time period between peaks will probably be 20-40 minutes. Reduce the reset in .1 R/M steps until the cycling stops. Remember to take the time between adjustments to allow the process to settle out.

4. With the PB and RESET set according to Step #2 and #3, move the SP upscale from the present SP by at least 20%. If the present SP is 450, the new SP should be at least 540. If this cannot be done due to process considerations, then allow the process to cool off. No matter the method, a step change in SP is required. A ramp of the PV is needed to check the overshoot of the PV, in order to adjust the RATE. Starting the system up in the morning may be the only way to get a ramp of the PV. After seeing the overshoot on the Plot Function, turn on RATE to a small number such as .08, for a small overshoot and a larger number like .2, for a larger overshoot. Keep increasing the number until there is no overshoot. If, the RATE gets too large, the PV will undershoot. If undershooting occurs, reduce the RATE setting in small steps until it is eliminated. This is the RATE setting when little or no over or undershooting occurs.

The above steps may be time consuming, especially at first. With experience the tuning process can be quick and straight forward.

Many processes have been controlled with the following values:

**PB=40 RESET=.4 R/M [150 SEC.] RATE=0 [OFF] FILTER=4**

### **8.2.3 OUTPUT FILTER**

There is no tuning step for the Output Filter. Adjusting the PID without the Filter gives the most accurate response of the control function of the PID modes. The Output Filter may be turned on anytime so desired. The number is increased as necessary to reduce cycling of the control output signal, thus reducing the cycling of the PV. Some typical settings of the Output Filter is 2, 4, 8, 12, and 15. Use of the Output Filter is not reflected in the PV except to make the PV more stable, the value of the PV is the actual response time of the Primary Element and its value.

### **8.3 ANALOGY OF PID CONTROL TERMINOLOGY**

The terminology of PID may be confusing to technical, as well as non-technical individuals, who have a need to have some understanding of PID control, due to work requirements. The comparing of an unknown to the known has been a relative easy way to explain a difficult subject for many years. The following analogy has been used for many years and very successfully. The PID terms have been equated to that of driving a car.

The little ole lady from Pasadena, the grandmother type, was out for a Sunday drive. As she was waiting at a stop light for the light to turn green, a young man who shall remain nameless, pulled up along side her. This young man had just received his driver's license and had Daddy's car out for the first time by himself. Pumping the gas pedal, he was gunning the engine and looking over at the little ole lady. Needless to say, that when the light turned green, he stepped on the gas hard. With burning tires, he squealed away, leaving the little ole lady behind. She in her turn, gradually stepped on the gas, gently bringing the car up to the speed of 30 mph. The young man in the meantime had reached the next stop light and it was red. He slammed on the brakes and came to a very quick stop.

While, waiting for the light to turn green, the young man was gunning the engine and watching in his mirror, as the little ole lady gradually came up behind him. As she approached the light, it turned green. She went through the light without needing to change the car speed, while the young man once again, stepped on the gas hard. They continued to repeat the same action over and over again. She proportioned her speed to reach each light as it turned green, while the young man was cycling between stepping on the gas or the brake. His gain was too high, as he reacted too fast to changing conditions. This caused cycling of his car speed to a on-off state, not to say anything about his Dad state, if he had known. The little ole lady had proportional control over her car speed by reacting gradually to changing conditions. This is known as the PROPORTIONAL FUNCTION.

Now, the little ole lady with proportional control was trying very hard to maintain the 30 mph. This was the speed that the traffic lights were set for, thus allowing the smooth flow of traffic. As she approached a fairly steep hill, her speed started to fall off. Her initial response was a proportional push on the gas pedal. This was not enough to hold the speed to the 30 mph and the speed was very slowly decreasing from the 30 mph she wanted. She very gently increased the pressure on the gas pedal, raising the speed back up to 30 mph. As she started to go down the hill, the

car speed started to slowly increase. She slowly backed off the pressure to the gas pedal, trying to maintain the 30 mph. This is known as reset, as she was resetting the engine speed to maintain 30 mph with changing load conditions. This is the RESET FUNCTION.

The little ole lady now was very close to home and had turned off the highway she was on. A couple of blocks in front of her, she could see the traffic light was green. As she was watching, the light turned yellow and then went to red. Upon seeing the light turn yellow, she took her foot off the gas pedal, because she had anticipated that she was going to stop, as the light was soon to be red. Now, the rate of approaching the light was too fast and she knew that she would coast into the intersection, if she did not step on the brake. By gently stepping on the brake, she could control the rate of approach of the car to the white line. If, upon stepping on the brake too lightly, she could overshoot the white line and go into the intersection. Then, by stepping on the brake too hard, she could undershoot, stopping way back of the white line and then would need to creep up to the white line. By applying the proper amount of braking, she was able to stop the car at the white line with no over or undershooting. This is known as the RATE FUNCTION.

With the OUTPUT FILTER of the Anafaze System, a new function had to be added to the analogy.

Remember the young man from the proportional section that had way too much gain? It seems that Daddy did find out and started to look for ways to curb the young man's appetite for rash action without cutting off his foot or waiting until he was 40 years old. Daddy's car is an 8 cylinder engine with a 4 barrel carburetor which reacted very fast to the young man's demand. Daddy acquired a 6 cylinder for his son to drive and decided after a couple of tickets for squealing tires, to replace it with a 4 cylinder.

The 8 cylinder is equivalent to no filter action, while the 6 cylinder is equivalent to a low filter number. The 4 cylinder would be a high filter number. A single cylinder engine would be equivalent to a very high filter number. By having a high gain due to youth and a low horsepower due to engine size, a fast response would not allow squealing of the tires. A response may be made, but not fast enough to hurt anything. Thus, a high filter setting would reduce high reactions to changing conditions. This is the OUTPUT FILTER FUNCTION.

## 9.0 SOFTWARE

ANAFAZE offers turn key software for IBM PC and compatible computers. The present software includes:

ANASOFT-32 Measurement and Control

ANASOFT-32-RS Measurement and Control with Ramp and Soak

ANASOFT-32-CP Measurement and Control with Carbon Potential

### 9.1 ANASOFT-32

ANASOFT-32 is a menu driven program that operates up to 3 ANAFAZE SYSTEM 32 units using an IBM PC or compatible computer. It provides a summary screen with color graphic displays of system operating conditions. A detailed, password protected, tuning screen allows entering of all control parameters, names for control loops, engineering unit and calibration factors, and other loop data. The program provides automatic data storage on diskette in LOTUS compatible files and automatic printout at user selected intervals. It is written in MICROSOFT QUICK BASIC and the source listings can be purchased so it can be modified by users.

#### 9.1.1 ANASOFT-32-RS: RAMP AND SOAK

For ramp and soak, ANAFAZE offers ANASOFT-32-RS, a software package that includes the capability for multiple ramp and soak recipes. ANASOFT-32-RS is a complete package that features convenient profile entry, graphic displays, warnings and alarms. Some of the features are:

**Independent Ramp and Soak:** Any loop in the system can be defined with a fully independent ramp and soak recipe. These recipes can be started, stopped, or put on hold independently as required.

**16 Segment Recipes:** Each profile can have up to 16 segments of ramp and soak and can be set for unlimited repeats.

**Easy Setup:** Ramp and Soak recipes are entered through a profile menu that includes a simple, fill in the blanks table of time verses setpoint.

**Recipe Storage:** Once a recipe is entered it can be given a name or number and stored on disk. The same recipe can then be for any loop. Up to 100 different recipes can be stored on disk at one time.

**Profile Storage:** ANASOFT provides for up to 20 profiles or control tasks to be stored on disk for the system. Each profile is a completely independent set of all system parameters. These parameters include setpoints, ramp and soak recipes, alarms warnings, input types, scaling and all other selected data. The desired profile can be selected from the initial system menu. When

the profile is selected the stored ramp and soak recipe for each loop is automatically setup.

**Accurate Recipe Tracking:** The ramp and soak software provides special alarms and warnings in addition to the standard features of ANASOFT. Tolerance levels are used for guaranteed soak, process warnings, and process alarms.

**Guaranteed Soak:** An independent tolerance band can be entered for each recipe segment. If the temperature is not within this tolerance band, the soak time is stopped and remains stopped until the temperature is within the band.

**Alarms:** A guaranteed soak time alarm can also be entered for each recipe. If the temperature is out of tolerance for longer than this entered time an alarm will occur.

**Data Storage:** Process data can be stored in LOTUS compatible files to analyze process performance.

### **9.1.2 ANASOFT-32-CP: CARBON POTENTIAL MEASUREMENT AND CONTROL**

The Anafaze 32 System may be used for heat treating applications to measure and control Carbon Potential. A Carbon Potential Input Module is added to the SYSTEM 32 to allow the connection of most carbon potential probes. The SYSTEM 32 software is expanded to provide the carbon potential measurement and control. ANASOFT-32-CP software is also available for IBM PC and compatible computers.

The Carbon Potential Input Module allows up to four inputs from carbon probes. The outputs may be dual time proportioning outputs for solenoid valve control or analog proportioning for motor positioning control.

The software provides for direct reading of the carbon potential of .15 to 1.4 %. The controller output for adding carburizing gas will be off, when the temperature is below the setpoint of the temperature probe. This will be adjustable from the tune menu of ANASOFT-32-CP.

The ANASOFT-32-CP software will allow ramp soak programs of the carbon and temperature setpoints for customer customized furnace profiles. The standard ANASOFT-32-CP will hold up to 100 furnace profiles and each profile may have up to 16 segments. The standard use of setpoints may be used without the use of the ramp soak programs.

## **9.2 CUSTOM APPLICATION PROGRAMS**

ANAFAZE maintains a staff of engineers that can provide assistance in generating software for custom applications. In addition ANAFAZE will design and

implement your entire turn key hardware and software system. Please contact your local representative or ANAFAZE directly for a quotation.

## 10.0 SOFTWARE COMMAND STRUCTURE

The SYSTEM 32 will respond to commands according to the following format. The commands generally follow the specifications of ANSI X3.28-1976. The structure is outlined below:

### 10.1. Commands from Allen Bradley Programmable Controllers (CMD)

The A32PID will respond only to Unprotected Block Read (CMD01) and Unprotected Block Write (CMD 08) commands from the Allen Bradley PLC. Any other command numbers received will return an error status code.

### 10.2. Error Checking (BCC / CRC)

Controller bit Switch 7 will select the method of error checking to be used. CRC is recommended for highest data integrity, BCC can be used when higher speed is necessary.

Switch Setting	Error Check
0	BCC
1	CRC

### 10.3. Protocol

Controller protocol is set for full duplex. Switch 8 is not used at this time.

### 10.4. Status Codes

Four Error Code numbers will be returned in the Status (STS) byte to denote the following error conditions :

Error Code (Hex)	Status/Error Condition
-----	-----
A0	Processor Reset
C0	Command Error
D0	Data Boundary Error
E0	[ Spare ]



### 10.4.1 Processor Reset

This Error Code is returned after :

- Power-up reset
- The watchdog timer resets the Master processor
- The Master processor resets the Slave processor

### 10.4.2 Command Error

This Error Code is returned when the A32PID receives a command that is not a Block Read or a Block Write.

### 10.4.3 Data Boundary Error

This Error Code is returned when:

- A Read command attempts to read beyond the 32 byte boundary of byte-size variables
- A Read command attempts to read beyond the 64 byte boundary of word-size variables
- A Read command is received that specifies the number of bytes to read as 0
- A Write command attempts to write beyond the 32 byte boundary of byte-size variables
- A Write command attempts to write beyond the 64 byte boundary of word-size variables

## 10.5. Data Table Addresses

Variable	Number Size		Addresses	
			Hex Byte Range	Octal Word Range
Prop. Gain	32	Byte	0100 - 011F	200 - 217
Rate	32	Byte	0120 - 013F	220 - 237
Reset	32	Byte	0140 - 015F	240 - 257
Input Type	32	Byte	0160 - 017F	260 - 277
Output Value	32	Byte	0180 - 019F	300 - 317
Output Type	32	Byte	01A0 - 01BF	320 - 337
Output Filter	32	Byte	01C0 - 01DF	340 - 357
Cycle Time	32	Byte	01E0 - 01FF	360 - 377
Alarm Deviation	32	Byte	0200 - 021F	400 - 417
Setpoint	32	Word	0220 - 025F	420 - 457
Measured Value	32	Word	0260 - 029F	460 - 517
Ambients	08	Byte	02A0 - 02A7	520 - 523
Digital I/O's	01	Byte	02A8	524
Alarm Status	08	Byte	02B0 - 02B7	530 - 533
Heater Check	33	Byte	02BC	536
EEROM Save	---	----	02BE	537
DACQ Input Type	64	Byte	02C0 - 02FF	540 - 577
DACQ Meas. Val.	64	Word	0300 - 037F	600 - 677


## 10.6. Input Types

The following one byte codes designate the various input types accepted by the SYSTEM 32:

Code	Input Type
00	Linear (0-60 mV)
01	J Thermocouple
02	K Thermocouple
03	T Thermocouple
04	[ Spare ]
05	[ Spare ]
06	RTD
07	Frequency (Pulse Counter)

## 10.7. Output Types

Output type codes are one byte hexadecimal designations formed by setting the individual bits, as explained below, to their proper state.

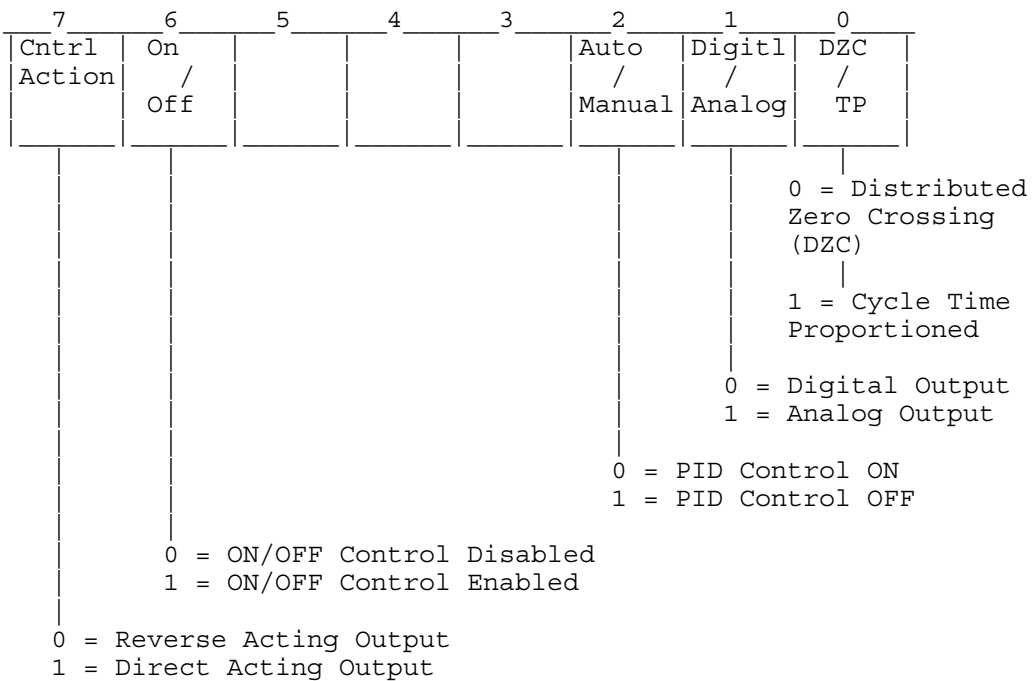

The following examples show the output code for specific output types:

<b>Output Configuration .....</b>	<b>Hex Code</b>
DZC Digital Output, Automatic control .....	00
Time Proportioned Digital Output, Automatic control .....	01
Analog output, Automatic control.....	02
DZC Digital Output, Manual Control .....	04
Time Proportioned Digital Output, Manual control.....	05
Analog output, Manual control .....	06
ON/OFF Digital Output, Automatic control .....	40
ON/OFF Digital Output, Manual control.....	44
DZC Output, Automatic Control, Inverted Output .....	80
Time Proportioned Output, Automatic Control, Inverted Output.....	81
Analog Output, Automatic Control, Inverted Output.....	82
DZC Output, Manual Control, Inverted Output .....	84
Time Proportioned Output, Manual Control, Inverted Output.....	85
Analog Output, Manual Control, Inverted Output .....	86
ON/OFF Output, Automatic Control, Inverted Output .....	C0
ON/OFF Output, Manual Control, Inverted Output.....	C4

## **11.0 TROUBLE SHOOTING INFORMATION**

These four items must work together to operate the SYSTEM 32:

The SYSTEM 32

The computer including the RS-232 or other serial interface

The communications link

The computer software

If the system does not work on initial start up check the SYSTEM 32 indicator lights, the computer, and the serial link.

### **11.1 Computer Problems**

The computer can be checked by running standard programs that use the display and the printer. The serial interface must be functioning. This is harder to test since most programs do not utilize the serial interface. Check any computer problems with the computer supplier.

### **11.2 Computer Software**

This can be divided into: ANASOFT-32 and user written software:

#### **11.2.1 User Written Software**

For user written software a simple routine that sends and receives a command from the SYSTEM 32 should be written and tested initially. The ideal routine sends and receives commands displaying both sets on the computer monitor. Since the protocol includes all characters, the display should show the hex numbers of the characters sent in both directions.

Once successful communications is established, this program can be used as a check if problems arise in the operating software.

#### **11.2.1 ANASOFT-32**

ANASOFT-32 is a complete menu driven software program which includes error detection and diagnostic messages. If ANASOFT-32 will not run at all please see the ANASOFT-32 manual for detailed information. The following can be checked:

1. Correct path for files -- run QINSTALL and check the disk drive and path for the data files.
2. All files present -- check that all necessary files are present and on the specified directory.
3. Sufficient memory free -- ANAFAZE-32 requires 512K memory free to run. You can use the DOS command CHKDSK to view the free memory. If there is insufficient memory check step 4.
3. Delete any memory resident programs -- check the AUTOEXEC.BAT to insure no memory resident programs are automatically run on start-up. Some memory resident programs may interfere with ANASOFT-32.

If ANASOFT-32 runs then the next step is to establish communications with the SYSTEM 32. When ANASOFT-32 is started the program asks for

the Edit or Run mode. Select the Run mode. If the SYSTEM 32 does not answer, a communications error message will appear on the display [see 11.3 and 11.4].

### **11.3 Communications Problems**

If the computer is functioning properly [section 11.1] then the communication interface, cables and connections must be checked. A number of problems have been traced to bad cables or connections.

#### **11.3.1 Serial Interface**

The serial interface must be correctly installed in the computer and set according to the manufacturers directions. ANASOFT-32 communicates using Comm Port 1. Some multi-function interface cards allow setting of the comm port -- this should be done correctly. In addition be careful that only one communications channel is set as comm port 1.

When the communications interface is correctly installed a scope can be used to check the transmit line to insure characters are being sent to the SYSTEM 32.

If a scope is not available, a test program [contact ANAFAZE] can be used that will display sent and received characters. The transmit line and the receive line can be disconnected from the SYSTEM 32 and connected together at the SYSTEM 32. The program can be run and characters typed on the keyboard will be sent to the SYSTEM 32 and returned to the computer directly on the communication line. If these characters are displayed on the monitor, the communication card, and the wiring can be assumed correct. Carefully re-connect the SYSTEM 32 and go to section 11.4.

### **11.4 SYSTEM 32 Problems**

A preliminary check of the SYSTEM 32 can be accomplished using the indicator lights on the Processor [A32-PIOM PROCESSOR I/O MODULE]. The lights function as follows:

#### **11.4.1 Processor: Ready Light -- Green, Communications -- Orange**

The Green Processor Ready light is the most important SYSTEM 32 indicator. If the green light is not on, the PIOM is not running and the SYSTEM 32 cannot operate.

If no other indicator lights are on, the power supply probably is not working. If the orange light is on, or is flashing, but the green light is not on, then the power supply is at least putting out a voltage.

But if the green light is not on, don't worry about what the computer is doing, or about communication problems. If the green light is not on, nothing will work.

If the green light is on, then the orange light is a communications indicator. The orange light will appear whenever the PIOM has decoded a communication containing the address of the PIOM as set in the DIP switch. Thus the conditions for establishing the orange light in the presence of the green light are:

- 1) PIOM working.
- 2) Host and PIOM set at the same BAUD rate.
- 3) PIOM address switches set correctly.
- 4) Host sending out proper communication containing correct address.

No other conditions are guaranteed to exist. For instance, this does not guarantee proper communication error checking protocols.

If the green light and orange light are both on, first check error protocol as set by the DIP switch and by Anasoft, then check the communication wiring. If the green light comes on but the orange light does not, then check the above in addition to checking the PIOM address switch and the BAUD rate.

#### **11.4.2 Process Ready Light is Off**

If on applying power to the controller, the GREEN READY light is not illuminated on the processor board mounting panel:

Use a voltmeter to measure the 5 VDC supply to the controller backplane to make sure that the voltage measures between 4.9 and 5.3 volts D.C. A low voltage detect circuit on the processor board will prevent operation if the supply voltage drops below 4.75 volts D.C. (+/- .1 volt).

If there is non power or a low supply check the AC input power, and the power supply output at the power supply terminals.

If power is present at the proper voltage contact ANAFAZE as the probable cause is PROCESSOR I/O MODULE problem.

#### **11.4.3 Orange Communication Light Remains Off**

Normally this will also cause a COMMUNICATION ERROR message when running Anasoft. If this occurs and the Green Light is on:

Verify that the communications options specified in the Anasoft Installation program (QINSTALL) match those specified by the option bit switch settings on the processor board. These options include the baud rate and the method of error checking to be used.

Verify that the controller address bit switch settings on the processor board are correct. If you have only one controller in your communications circuit it's address should be 0 (all address bit switches off).

Verify that you are using the COM 1 serial port on your computer. Anasoft assumes this to be the active communications port.

Verify the wiring connections between your computer and the Anafaze controller. For RS-232, only three wires (Rx, Tx and Gnd) are necessary to communicate with the controller.

Check the hardware communications option that was specified when you ordered your controller. If your processor module was modified for current-loop operation, it will not interface with a RS-232 circuit directly.

If all these items are checked and OK, contact ANAFAZE, the PROCESSOR I/O MODULE probably has a problem.

#### **11.4.5 No Control Outputs from PIOM**

The Anasoft operating program displays proper output values for each loop but the controller outputs remain off (0%).

Verify that the OUTPUTS ON input on the processor module is enabled. A low level (0 volts) signal is necessary at this terminal to enable operation of controller outputs. This connection is made at TB2, pin 35. NOTE: This may be accomplished by connecting a jumper on TB2, between pin 32 (GND) and TB2, pin 35.

Check the action of the communications watchdog timer. This may be enabled and will set all control outputs to manual with zero output if communications is not maintained by the host computer. Please see section 3.3.2 for details.

#### **11.4.6 Measured Data Errors**

If the input data does not appear to be correct or remains constant, check the indicator lights on the analog input boards (RRAIM or SSAIM). The green light indicates that the isolated supply is working properly, and a flashing orange light indicates that the input module is scanning.

If the green light is not on and the PIOM has passed all the previous conditions, then the most likely fault is in the input module. If the green light is on and the orange light is not flashing, then the problem is probably in the PIOM but could be in the input module. If the green light is on and the orange light is flashing, then the problem is probably the input module, the system wiring, or the transducers.